OCALA ELECTRIC UTILITY OCALA, FLORIDA

FIRST REVISED SHEET NO. 19.0 CANCELS ORIGINAL SHEET NO. 19.0

#### APPLICATION FOR INTERCONNECTION OF CUSTOMER-OWNED RENEWABLE GENERATION SYSTEMS

TIER 1 - Ten (10) kW or Less

TIER 2 - Greater than 10 kW and Less Than or Equal to 100 kW

TIER 3 - Greater than 100 kW and Less Than or Equal to Two (2) MW

Note: These customer-owned renewable generation system size limits may be subject to a cumulative enrollment limit on net-metering customers located in the area served by the City of Ocala Electric Utility. Please refer to the Ocala Electric Utility Net-Metering Rate Schedule.

Ocala Electric Utility customers who install customer-owned renewable generation systems (RGS) and desire to interconnect those facilities with the Ocala Electric Utility system are required to complete this application. When the completed application and fees are returned to Ocala Electric Utility, the process of completing the appropriate Tier 1, Tier 2 or Tier 3 Interconnection Agreement can begin. This application and copies of the Interconnection Agreements may be obtained at Ocala Electric Utility, located at 201 SE 3rd Street, Ocala, Florida 34471, or may be requested by email from OEU@ocalafl.org.

1. Customer Information
Name: Bruan Bakey
Mailing Address: 6136 CV5000 IP. Pd
City: COLC State: FL Zip Code: 34474
Phone Number: 208-390-9722 Alternate Phone Number: 208-390-9722
Email Address: By Cin Rawa 6001. COMFax Number:
Ocala Electric Utility Oustomer Account Number: 502809 - 201612
2. RGS Facility Information
Facility Location: Oycund Munted Sour
Ocala Electric Utility Customer Account Number: 302809 - 201612
RGS Manufacturer: 511 406 2 ENPhose
Manufacturer's Address:
Reference or Model Number:
Serial Number: SiL-30HC & Enphase TQ8PIUS

(Continued on Sheet No.19.1)

Issued by: Michael Poucher, P.E.
Electric Utility Director

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continue from Sheet No. 19.0)

FIRST REVISED SHEET NO. 19.1 CANCELS ORIGINAL SHEET NO. 19.1

#### 3. Facility Rating Information

Gross Power Rating: Quy "Gross power rating" means the total manufacturer's AC nameplate generating capacity of an on-site customer-owned renewable generation system that will be interconnected to and operate in parallel with Ocala Electric Utility's distribution facilities. For inverter-based systems, the AC nameplate generating capacity shall be calculated by multiplying the total installed DC nameplate generating capacity by 0.85 in order to account for losses during the conversion from DC to AC.)

Fuel or Energy Source: Solar ParelS

Anticipated In- Service Date: 12/2/2022

#### 4. Application Fee

The application fee is based on the Gross Power Rating and must be submitted with this application. The non-refundable application fee is \$375 for Tier 2 and \$750 for Tier 3 installations. There is no application fee for Tier 1 installations.

#### 5. Interconnection Study Fee

For Tier 3 installations, a deposit in the amount of the estimated costs of the study (to be determined at time of application) must be paid along with this application in addition to the application fee referenced in Article 4 above. This deposit will be applied toward the cost of an interconnection study. The customer will be responsible for the actual costs of the study. Should the actual cost of the study be less than the deposit, the difference will be refunded to the customer. Customer agrees to comply with all interconnection requirements identified in the interconnection study report.

#### 6. Required Documentation

Prior to completion of the Interconnection Agreement, the following information must be provided to the Ocala Electric Utility by the customer.

- A. Documentation demonstrating that the installation complies with (or most current version at time of inspection approval):
  - 1. IEEE 1547 (2018) Standard for Interconnecting Distributed Resources with Electric Power Systems.
  - 2. IEEE 1547.1 (2005) Standard Conformance Test Procedures for Equipment Interconnecting Distributed Resources with Electric Power Systems.
  - 3. UL 1741 (2010) Inverters, Converters, Controllers and Interconnection System Equipment for Use with Distributed Energy Resources.

(Continued on Sheet No. 19.2)

Issued by: Michael Poucher, P.E. Electric Utility Director

Doc ID: 4f928bd1724124d0773eae04a05350d3eeb98c32

#### OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 19.1)

#### FIRST REVISED SHEET NO. 19.2 CANCELS ORIGINAL SHEET NO. 19.2

B. Documentation that the customer-owned renewable generation has been inspected and approved by local code officials prior to its operation in parallel with the Ocala Electric Utility system to ensure compliance with applicable local codes. OEU will also require proof of commission testing by a qualified 3rd party testing company (not affiliated in any way with the manufacturer, vendor or installation contractor), for compliance with all required and applicable codes, standards, and interconnection study requirements, prior to setting of OEU metering equipment.

C. Proof of insurance in the amount of:

Tier 1 - \$100,000.00

Tier 2 - \$1,000,000.00

Tier 3 - \$2,000,000.00


Customer


By: Brush Bond Date: 119/23
(Print Name)

(Signature)

Issued by: Michael Poucher, P.E. Electric Utility Director

E 1300 82-5142	11	20.3 Cr sec		\$1,216	001896500	\$17 BACLUDED	2013	\$1,418 319 (\$378)	222	98.	Processed Date: 05/05/2022	
CITIZED PROPERTY MSURANCE CORPORATION 301 W BAY STREET, SUITE 1300 JACKSONVILLE PL 32202-0142	y - Declarations 22 TO 0A052923 5 Replace Permits	Agent F1. Agent Lie. 6: E193000. 1 AJGGE LEWIS IMPURIANCE AGENCY INC ANGELA LEWIS AGE FORT YANG STHEET GCALA, F1. A4411 Phone Hamber 382-291-2444 Gitsens Agency 104, 33007	uctible: \$5		064 08 000 08 000 08	\$ 100,000 \$ 100,000	Name of the last	SUBTOTAL		a Coverage is \$478.	Processed C	
Canzel	Mobilehomeowners MHO-3 Spechal Form Policy - Declerations Nobel Policy - PROM 0406/2022 TO 100 AT 10	Lectation Of Periodence Promises: Agent 8 of 150 No. 2010-10. ACCEL 10. CCLALA FI 24470-1706 CCLALA FI 24470-1706 CCLALA FI 24470-1706 CCLALA FI 24470-1706 CCLALA FI 24470-1704 CCLALA FI 24470-1704 CCLALA FI 24470-1704 ACCEL 1707-1707-1704 CCLALA FI 24474-1707-1707-1707-1707-1707-1707-1707-		C LIMIT O				d-Up Presedum: and Chenge:	unton (FIGA) Regular Assessment ocuston (FIGA) Regular Assessment s and Assestance Trust Fund (EMPA)	SSESSMENTS AND ALL SURCHAROES Hon-Humann C	First Named Interest	
CITIZENS	Mobilehome POLICY NÚMBER: 06033330 - 1	Hemod beared and trains Additional Memod beared and trains Additional Memod Browned.  6 136 NE. Additional Additional and Additional Additional Additional Additional Additional beyonds/1/2000 com.	18:400	SECTION I - PROPERTY CONSTANCES	A Design Brokes B Ober Brokes C Persons Property	BECTION III - LIABELTY COVERAGES E PRINCES LIABELTY	F. Martin Payments OTHER COVERAGES Paragral Property Replacement Cert	Florida Hurricana Catastrophe Fund Bulld-Up Premium: Premium Adjustment Due To Allowable Rate Change:	MANDATORY ADDITIONAL CHARGES. 2022 Flants Insurence Gussenty Association (FIGA) Regular Assessment 2022-8 Foots Insurence Gussenty Association (FIGA) Regular Assessment Ensurency Management Properedness and Assistance Trust Fund (EMPA) Tax & Emergency Management Properedness and Assistance Trust Fund (EMPA).	TOTAL POLICY PREMIUM INCLUDING ASSESSMENTS AND ALL SURCHARGES. The portion of year premium fac. Humann Converge is \$550	Authorized By: ANGELA LEWIS	DEC MHOS 12 19

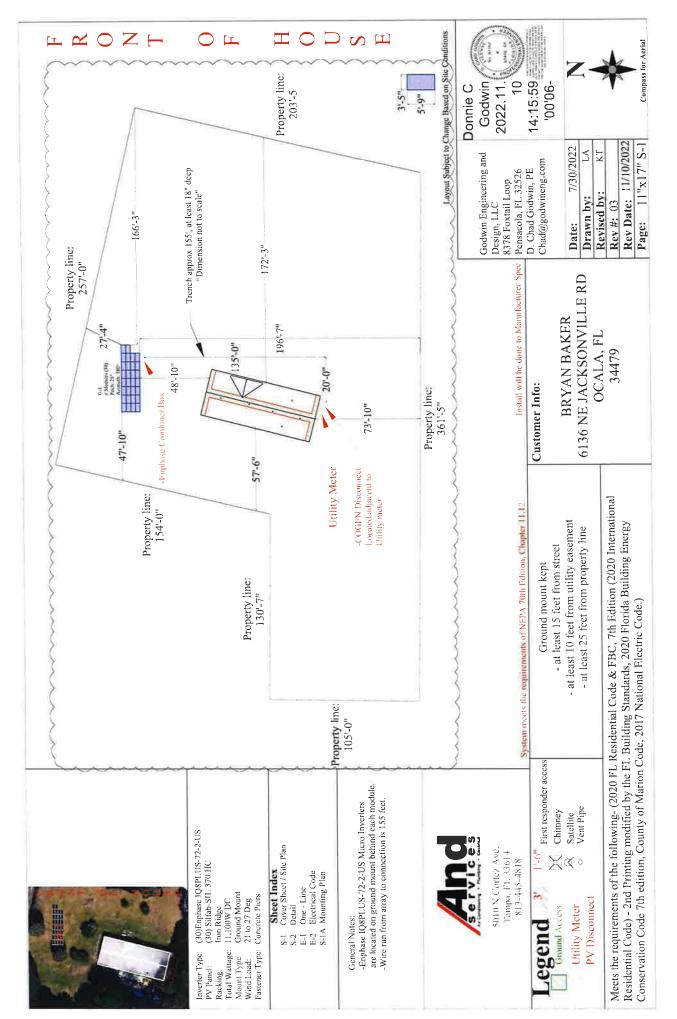

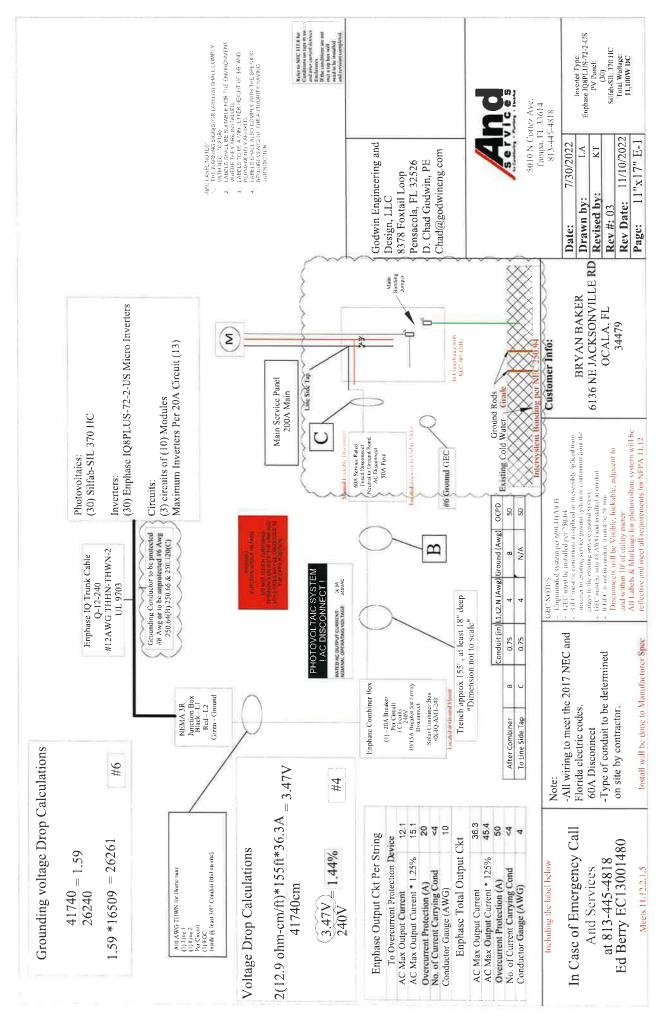



884 or 832 (California) 34 or 32 (California) 26 or 26 (California) ≥ 97.1% end 1styr ≥ 91.6% end 12thyr ≥ 85.1% end 25thyr ≥ 82.6% end 30thyr 53.15 in, ø 0.22 in (12AWG), MC4 from Staubil 69.4 in x 40.8 in x 1.37 in 112.8 lb/It\* rear load / 112.8 lb/It\* front load 0.126 in high transmittance, tempered, DSM antireflective coaling 276 276 11 8 8 50 11 16 954 120 Halfcells Stimono PERC 9 busbar - 3.26 x 6.53 In SHIPPING SPECS Modules Per Pallet: Pallets Per Truck 3 diodes, 305Q0451 (45V max 0C blocking voltage, 30A max forward rectified current) UL 3730 Centified, IEC 62790 Certified, IPG6 rated e 1 in at 51 6 mph IMPERIAL Module product workmanship warranty Linear power performance guarantee ULCOBD.C.1913, VI 1703, CEC Gered, UL 61715 V/7-1772, UL 61730-1/72, IEC 67716
IEC 61215 7-1/177". IEC 61730-1/27". CSA.C.22 5461730 1/7-2/1C 67716
Ammon'a Cotrosiony IEC 61701.22011. Salt Mist Corrosion Certified, UL Fire Making: Type 2 1000 370 Hessurement candi unics. S. E. 1000 Wyork. AM. 1.5 - Lemperature. 25 °C - HOCL BOD Wyork. AM.1.5 - Measurement uncertainty s. 132. Sun simulator casilization reference produces from fraumhofer restitute. Electureal characteristics may vary by 5% and power by DTo + LOM. WARRANTIES 3.2 mm righ transmittance, lempered, DSM antireflective coating 1350 mm, ø 5.7 mm, MC4 from Staubil 19.5kg ±0.7kg 1762 prom x 1037 mmx x 35 mm 5400 Pa rear isolt / 5400 Pa front laad STC 370 34.95 10.66 41.75 20.2% 110 Naticelly Strength Hilling 9 bushar - 83 x 166 mm METRIC 3><><\$><\$ SOB001:2015 -0.364%/°C -0.28%/°C -0.36%/°C 40/+85 °C MECHANICAL PROPERTIES / COMPONENTS Module weight
Dimensions (H x L x D)
Maximumsurface load (wind/snow)\* ELECTRICAL SPECIFICATIONS Test Canditions
Madule Pswer (Pmast)
Maximumpower voltage (Vpmax)
Maximumpower current (Ipmax)
Dpen circuit voltage (Voc.) Maximum system voltage (VBC) Series fusr rating TEMPERATURE RATINGS Temperature Coefficient Isr Temperature Coefficient Voc Temperature Coefficient Pmax Short circuit current (Isc) Madule efficiency Operatinglemperature CERTIFICATIONS Bypass diades Junction Box NOCT (± Z'C) Backsheet Product Tactory

A waring Road the Safey and invalation viewed to more integrated readous and refore banding installing and aper in 13 years tablect to registration by the state of the second of the state of the second of the sec

SILFAB SOLAR INC.

STEFADSOLAR LUR

240 Courtneypark Drive East Mississauga ON L5T 2Y3 Canada T +1 905.255,1501 F +1 905.696 0267 SIII.ab. - SIL-370-HC-20210803 ha repediction of Jry lived is allowed without permission but and information in which to madications without rotice is 54th Solat Inc. 1211 Subb Solat "a a redemark of Sub Solat Inc. 800 Cornwall Ave Bellingham WA 99225 USA T +1 360,569,4733 inlo@silfabsolar.com 1770 Port Drive Burlington WA 94233 USA T +1360 569 4733 [mm5e0r] "8.0A "4,r [mm28] 14" [356mm] -20 [mm7] -30 [mm8r] 41.3" [1050mm] 69.4" [1762mm]  $\oplus$ Wounting Hole (x4) -Oranage Hole (x8) 1.4" [35mm] 2.4° [60mm] 14" [356mm] мил коед

SILFABSOLAR COM

Dependable, durable, high-performance solar panels

engineered for North American homeowners.

SELVAD

2 Standoler

) <u>|</u>

(1)

CE





# IQ8 and IQ8+ Microinverters

Our newest IQB Microinverters are the Industry's first microgrid-forming, software-defined microinverters with split-phase power conversion capability to convert DC power to AC power of Convert DC power to AC power efficiently. The brain of the semiconductor-based microinverter is our proprietry application-specific integrated dirout (ASIC) which enables the microinverter to operate in grid-tied or off-grid modes. This chip is built in advanced Schim technology with high speed digital logic and has super-fast response times to changing loads and grid events, alleviating constraints on battery sizing for home energy systems.





(OB Series Microliventials realative reliability standards with more than one million countaility hours of power-can testing, enabling an industry-leading limited warranty of up to 25 years.



108 Series Microliverlairs are Ut. Listed as PV Rapid Shut Down Equipment and conform with various regulations, when installed according to manufacturer's instructions:

Connect PV modulas qulckly and easily to IOB Series MicroInverters using the included Q-DCC-2 adspter cable with plug-n-play MC4

© 2021 Exphase Energy, All rights reserved, Enphase, the Enphase logo, IOB microinverters, and other nemes are trademarks of Enphase Energy, Inc. Data subject to change,

IQ8SP-DS-0002-01-EN-US-2021-ID-19

### Easy to install

- Lightweight and compact with plug-n-play connectors
- Power Line Communication
   (PLC) between components
- Faster Installation with sImple two-wire cabling

## High productivity and reliability

Produce power even when the grid is down

· More than one million cumulative

- hours of testing Class II double-insulated
- enclosure Optimized for the latest high-

## Microgrid-forming

powered PV modules

- Complies with the latest advanced grid support
- Remote automatic updates for the latest grid requirements
- Configurable to support a wide range of grid profiles
- Meets CA Rule 21 (UL 1741-SA) requirements

## IQ8 and IQ8+ Microinverters

Control by and fordule packing   2015 - 300   2015 - 40			106-80-2-03	1000105-27-5-05
litty  tage  tage  tage  to Condulate  tourent  sion  sion  sion  sion  sion  toy  wy  without power  wh  tourent  toure	Commonly used module pairings!	W	235 - 350	235 - 440
gas  lage  module sc   frondule sc   fournent  alion  wh  age/fraiga²  reger/fraiga²  wy  reger/fraiga²  wy  reger/fraiga²  wy  reger/fraiga²  wy  reger/fraiga²  fraiga  location  ww  fraige  pe  xD   consumption  mw  fraige  pe  xD   consumption  mw  fraige  pe  xD   fraige  f	Module compatibility	-09	cell/120 half-cell	60-cell/120 hall-cell and 72-cell/144 half-cell
inge  incodulated	MPPT voltage range	*	27 – 37	28-45
rage  Rage  For pour  For pour  For pour  For pour  Again/cargo <sup>2</sup> W  Again/cargo <sup>2</sup> W  W  W  Again/cargo <sup>2</sup> W  W  W  W  Cart. D Nameh carrent  For pour  For pour	Operating range	×	25 - 48	25 - 58
Findule is c)  CD port  I courrent  alion  Again/arage <sup>3</sup> Way  way range  AC port  I courrent  I courrent  AC port  I courrent  I courren	Min/max start voltage	*	30 / 48	30 / 58
renodulated   Commontain   Comm	Max Input DC voltage	>	90	09
to Do port  fournent  allon  art  fournent  A (L-1) Abanch curent  A	Max DC current <sup>2</sup> [modulelsc]	*	(5)	
Fourent Parish Countries Parish Parish Parish Parish Parish Parish Parish Countries Parish Parish Countries Parish Parish Countries Parish Par	Overvoltage class DC port		300	
alion  with power  where  we with the current  we with the current  we with the current  we with the current  we will the current  we w	DC port backfeed current		0	
are with power was again family and again family with a second and a family as A (L-L) Manch circuit*  as AC port content max as AC port content max and a AC port a A	PV array configuration	Ix1Ungrounded aira	y. No addillonal DC side protection required. At	Sade protection requires max 20A per blanch circuit
Prower VA  Tous output gover VA  Tour output output VA  Tour output VA  Tour output out	GUTFUT BATA IACI		100+60-5-01-	1989405-72-2-05
ous output power who was a point power who was a point power with the power of the power of the power of the power of the power factor (adjustable) was a did adjustable was a did bloomer consumption may plantature range and the year of the power consumption may be at 1 m gree at 1 m gree	Peak output power	VA	245	300
L) voltagar/araga² rous extiput current Hz quency range Hz Ar 20 A(L.) than-ch circuit* Includes to C port A feed current A fe	Max continuous output power	*	240	290
Per quency range Hz roomanity range and puency range Hz roomanity range hz roomanity range relative for distriction and seless AC point five distriction and relative range and efficiency wer functor (edustable) % so and efficiency % and efficiency were consumption mix relative range for the type (HxWxO) was at 1 m gree equry / UV exposure rating egory / UV	Nominal (L-L) voltage/range <sup>3</sup>	*	240 / 211 - 26	
Hz  ar 20 A (L. L) kanch circuit*  nic distortion  ob Subs AG port  filed current  wer lactor (edjustable)  Nover consumption	Max confinuous output current	•	0.1	1.21
He are an ord A (L-1) kanch checuit*  In chaisarrian  In chaisarrian  A feed current  A feed current  A feed current  A so defficiency  A so deficiency  A so defic	Nominal frequency	24	09	
nr 20 A (L-L) tranch chrouit* nic dissertion oblass AC port r setting r setting wer Inclor (edjustable) % Sover Consumption mW ONE CONSUMPTION MW	Extended frequency range	74	50-68	
nic distortion solass AC port kfeed courent re setting wer fuctor (edjustable) word fuctor (edjustable) word deficiency schooler consumption mountaine range of the type (HwWx.D) (HwWx.D) (Hww.X.D)	Max units per 20 A (L-L) branch circuit*		16	13
Afeed couremt m.A. Afeed couremt m.A. Ar setting M. M	Total hermonic distortion		%9>	
reetung reetung reetung reetung reging	Overvoltage class AC port		≡	
wer factor (edjustable)  Toy  A do alticlercy  A sower consumption  My ower consumption  My ower foreign  Hot yea  (HxWxD)  Stee  Green  To yea  To yea  Hot Ocations  Stee  To yea  T	AC port backfeed current	тÅ	30	
wer tactor (edjustable)  your of efficiency  your over consumption  MY  OWE  OWE  (HAVE)  (HAVE)  (HAVE)  (FROM  OFFI  O	Power factor setting		1.0	
od elficiency s od elficiency s over consusption mw mountaine range provides and the same (HxWC) (HxWC) sie at 1 m gree elgony / UV exposure rating elgony / UV exposure rating free	Grid-tied power factor (adjustable)		0.85 leading - 0.85 l	BulßBa
A cover consumption mw ONA cover consumption mw ONA cover consumption mw ONA cover consumption cover c	Peak efficiency	*	07.5	97.6
Power consumption mW phrature range indity range tor type (HxWAC) is as it in gree agony / UV exposure rating rene individual indivi	CEC weighted efficiency	x*	97	28
npurature range ndiry range tor type (HwWxD) sisa at im gree agony / UV exposure rating	Night-1lme power consumption	Wm	09	
ngurature required required required required required to the type (HwWxD) (HwWxD) (HwWxD) (HwWxD) (HwWxD) (HwWxD) (HwwD) (HwWxD) (HwwD) (HwwD	MECHANISAL DATA			
nidity range (HxWkD) (HxWkD) sis at 1m gree egory / UV exposure rating	Amblent temperature range		-40°C Io +60°C (-40°F	Lo +(40ºF)
(HAWA) (HAWA) sis at 1 in gree egory / UV exposure rating	Relative humidity range		4% to 100% (conde	nsing)
(HwWxD) sv wet locations ssa at im gree egory / UV exposure rating	DC Connector type		MC4	
ist at 1m gree gree egory / UV exposure rating	Dimensions (HxWxD)		212 mm (8.37) x 175 mm (6.97)	x 30.2 mm (1.2")
sise at 1m gree gree agory / UV exposure rating	Weight		108 kg (2.38 lb	(8
vives forestons dree gree agory / UV exposure rating	Caoling		Natural convection -	no fans
dree gree egory / UV exposure rating	Approved for well locations		Yes	
Bujte amsode A/ / Aoffe	Acoustic noise at 1 m		<60 dBA	
agory / UV exposure rating	Pollution degree		PD3	
egony / UV exposure rating	Enclosure		Class II double-Insulated, corrosion resi	stant polymeric enclosure
8	Environ category / UV exposure rating		NEMA Typs 6 / aut	door
	COMPLIANCE			
		CA Rule 21 (UL 1741-SA),	UL 62109-1, ULI74I/IEEE1547, FCC Part 15 Clas	is B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01
	Cortifications	This product is UL Listed 690.12 and G22.1-2018 F manufacturer's Instructi	as PV Rapid Shut Down Equipment and confo tule 64-218 Rapid Shutdown of PV Systems, for ons.	rms with NEC 2014, NEC 2017, and NEC 2020 section AC and DC conductors, when installed according to
the second secon			/ W. C.	

(I) No enforced DC/AC ratio, See the compatibility calculator at https://link.enphase.com/ module-compatibility (2) Natimum-continuous input Occurron is 1068 ACN Nommal voltage range can be extended beyond nominal if required by the utility (4) Limits may vary. Refort to local requirements to deline it he number of inscriniveners per branch in your area.

IQ8SP-DS-0002-01-EN-US-2021-10-19

### 1Q Combiner 4/4C X-IQ-AM1-240-4 X-IQ-AM1-240-4C Enphase



modern uncluded only with 10 Combiner 10) providing a consistent, pre-willed solution fai esidensial applications. It offers up to four microinverters and storage installations by nto a single em losure and smaniferes (Q 2 pole input circuits and Eaton BR series consolidates interconnection raugiment 10 Gateway and integrated LTE-M1 cell busbar assembly

The Enphase IQ Combiner 4/40 with Emphase

#### Smart

- Includes IQ Gateway for communication and central includes Enphase Mobile Connect cellular modern (CELLMODEM MF 06 SP 05) included only with IQ
  - Combiner 40
- \* Includes sclar sheld to match Enphase IQ Battery aesthetics and deflect heat.
   Flexible networking supports Wi-Fi,

  - Ethernet, or neilular Optional AC receptatife available for PLC bridge Provides production metering and consumption moriforing

#### Simple

- Centered mounting brackers support single stud mounting
   Supports bottom, back and side conduct entry
   Supports bottom, back and side conduct entry
   Up to four 2 pole heanes ortcuits for 240 VAC plugi-in breakers fror included)
   80% total PV or storage bracinic crounts

X-IQ-AM1-240-4C

#### Reliable

- Durable NRTL-certified NEMA lype 3R englosure
- Five-year Imited warrauty
  Two years labor reintbursement program coverage included for both the IQ Combiner SKUs
  UL listed



## Enphase IQ Combiner 4/4C

and the second s	
MODEL NUMBER	
IQ Compiner 4 (X-IC-AM1-240 4)	Itą Combines 4 with financiesie 10 satrowej ninned circuit traind for integrated mere grade. M pozudobis motedinaj MMSI 122 JV JESPS ISPS and consumption nomitoming IV-2 SM. I includes a substantial abried to motich the IQ Battery system and 10 System Commilley 2 and roblified News.
RECLIMBINES ACTOR/GRANELEO RE-AGO	P. Do ninne, Ascanli, Espocae D. Gapatary mined month, conflictin megapord reviews upor le profit estimate intervenging and a 2012 and consequently monated to 3.9. In factor's includes Young Connect military without profit Connect military without a 2012 and connect military without profit that the 2012 and a subject profit profit in observed as a formatter in the 2012 and a subject person of the 2012 and a subject profit in the 2012 and a subject profit in the 2012 and a subject person in the 3.0 value placed as the size as a subject person in the 3.0 value placed as the size as a subject person in the 3.0 value placed as the size as a subject person in the 3.0 value placed as the size as a subject person in the 3.0 value placed as the size as a subject person in the 3.0 value placed as the 3.0 value placed as the size as a subject person in the 3.0 value placed as the 3.0 value p
ACCESSORIES AND REPLACEMENT PARTS	(not metaded, order reportably)
Ensemble Communications Pri COMMS-CELEMBEM-N 1-06 CELEMBEM-AFFER-N-05 CELEMBEM-AFFER-N-05	Includes COMMAS VIT-01 and CELLMODEA-04)-40-50 GS with Syeur Sprint data pion for Encounter since GROSS OF LIFEM Technism modern with Syeves Sprint issue above 4G based LIFEM Technism modern with Syeves SIATO data alen
Canoni Brokes, Ber Chango IIIV Ber Chango IIIV Ber Chango IIIV Ber Chango IIIV Ber Chango IIIV	Supports Fulsion (RCVD, BRZ15, SRZ20); 8RZ20; 8RZ20; and 8RZ60 circuit brearon.  Chart to receive J. Debb. Tob, Calcida (RCV)  Christia
EPLC:01	Power line carner (communication bridge pair), quantity - one pair
XAISOLARSHIELD (FS	Replacement solar shield for 10 Combiner 4/4 E
XA-PUG-120/3	Accessory receptable for Power Line Carther in 19 Combiner 4/4/C (required for EPLC-01);
XA.CNV-DUA-3	Poplacement IG Gateway printed organizated (PCB) for Combiner 4/40.
Aughla Hollask	FIGURDAMPACTOC CATOLICITE OCCURS MACCOLISMOS
ELECTRICAL SPECIFICATIONS	Continuous duis
Section ordinas	20/2/6 9/4G, 60 Hz
Ealon BR series busbar raving	125.4
Max continueus surrentrating	65.8
Max continuous current taxing main from PV/stotage	64.△
Max fusezerreurtrating toutput)	96 A. Timese Serve And Essere RR service Distributed Renoration (DR) broakers unit (Inol Included)
algerial critical sold around avoided.	
Max i olal branch circuit be-akei rating (input) Production melemp 07	RQA et distributed generation / Yew with III cateway product inclined. 280 A solid core pre-installed and wired to IQ Gateway.
Consumption monitoring CT ICT Z59"sPUIT)	A pair of 200 A split core turrent fransformats
MECHANICAL DATA	
Dimensions (WxHxD)	37 5 x 49 5 x 16 6 cm (14 75 * 2 19 5 x 6 637). Height is 21 06" (53 5 cm) with mounding brack+1s
weight	7.5 kg (16.5 kbz)
Ambient temperature range	-40° C to ≠46° C (-40° to 115° F)
Saeting	Natural convection, plus heat shalld
Enclosure environmental ration	Gutanos NR N-Geruffed, NERA type 3R, pulycarbonate construction
Wilespes	<ul> <li>20 A loss A header impose so if an advise frequent interval of a function of the construction of the construction of the 100 April couper construction.</li> <li>A construction of the 20 April couper construction.</li> <li>A span flag, and under couper in the 20 April couper construction of the couper construction.</li> <li>A flag of the couper construction.</li> <li>A flag of the couper construction.</li> </ul>
Albude	ID ZAIDD HIRARDA (a. DOO rees)
INTERNET CONNECTION OF HONS	B02.11k/g/ñ.
Cellular	DELLYODENMENT (ID SELD), DELLYMDERMENT OM ATT GOMEN SKRITT. EL ATT CENTUR montenië. Nane dost an Enghave. Aktink Connectaelliske monten as reprinced for all Presentee rescalistions.
Ethernet	Optional, 892-3, CanSE (or Catió) UTP Ethernet cable Inot included.
COMPLIANCE	
Compliance 10 Continuer	Un 1941, CANUGA 722 X bis 101. 4 O'ER Part 15, Class B, ICES 003 Production meter on ANSI CD2 Usecuresy class 8, U5 (PV production) Consumption metering accounts class 2.5
Consplance It datestay	נון מפפטיוול אוניסאל בביבות מוחיים

To learn more about Enphase offerings, Visit enphase com



KIDAM1246-4
LISTED
To learn more about Enphase offerings, visit <u>enplase.com</u>

#### OCALA ELECTRIC UTILITY OCALA, FLORIDA

FIRST REVISED SHEET NO. 20.0 CANCELS ORIGINAL SHEET NO. 20.0

#### Tri-Party Net-Metering Power Purchase Agreement

This Tri-Party Net-Metering Power Purchase Agreement (this "Agreement") is entered into this
day of (VI) VIVI ( 20 9% by and between the Florida Marie 17 senered into this
day of (1) (W) 20 25, by and between the Florida Municipal Power Agency, a
by with the law of the state of Florida
(hereinafter "FMPA"), the City of Ocala doing business as Ocala Electric Utility, a body politi
(neremarker OEO), all 11/11/11/11/11/11/11/11/11/11/11/11/11/
electric customer of OEU (hereinafter "Customer").
Customer Customer J.

#### Section 1. Recitals

- 1.01. OEU and Customer have executed OEU's Standard Interconnection Agreement for a Customer-Owned Renewable Generation System (RGS) pursuant to which OEU has agreed to permit interconnection of Customer's renewable generation to OEU's electric system at Customer's presently-metered location, and Customer has agreed to deliver excess electric energy generated by Customer's Renewable Generation System to OEU's electric distribution system;
- 1.02. The City of Ocala and FMPA have entered into the All-Requirements Power Supply Contract, dated as of May 1, 1986, (hereinafter the "ARP Contract") pursuant to which the City of Ocala has agreed to purchase and receive, and FMPA has agreed to sell and supply OEU with all energy and capacity necessary to operate the OEU electric system, which limits OEU's ability to directly purchase excess energy from customer-owned renewable generation.
- 1.03. In order to promote the development of small customer-owned renewable generation by permitting OEU to allow its customers to interconnect with OEU's electric system and to allow OEU's electric customers to offset their electric consumption with customer-owned renewable generation, FMPA, in accordance with the terms and conditions of this agreement, has agreed to purchase excess customer-owned generation from OEU's electric customers interconnected to OEU's electric system.

NOW THEREFORE, for and in consideration of the mutual covenants and agreements set forth herein, the Parties covenant and agree as follows:

#### Section 2. Interconnection

2.01. Customer shall not begin parallel operations with the OEU electric distribution system until Customer has executed OEU's electric Standard Interconnection Agreement for Small Customer-Owned Renewable Generation and is in compliance with all terms and conditions

OEU requires that the customer install and operate the RGS in accordance with all applicable safety codes and standards. OEU shall establish and enforce terms and conditions of operation and disconnection of all interconnected customer-owned renewable generation as it relates to the effect of the RGS on OEU's electric distribution system.

(Continued on Sheet No. 20.1)

Issued by: Michael Poucher, P.E. Electric Utility Director

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 20.0)

FIRST REVISED SHEET NO. 20.1 CANCELS ORIGINAL SHEET NO. 20.1

#### Section 3. Metering

3.01 In accordance with the OEU's Standard Interconnection Agreement for Customer-Owned Renewable Generation, OEU shall install metering equipment at the point of delivery capable of recording two separate kWh meter readings: (1) the flow of electricity from OEU to the Customer (Delivered), and (2) the flow of excess electricity from the Customer to OEU. OEU shall take meter readings on the same cycle as the otherwise applicable rate schedule.

#### Section 4. Purchase of Excess Customer-Owned Renewable Generation

- 4.01. Customer-owned renewable generation shall be first used for Customer's own load and shall offset Customer's demand for OEU's electricity. All electric power and energy delivered by OEU to Customer shall be received and paid for by Customer to OEU (Received) pursuant to the terms, conditions and rates of the OEU otherwise applicable rate schedule.
- 4.02. Excess customer-owned renewable generation shall be delivered to the OEU Electric distribution system. For purposes of this Agreement, the term "excess customer-owned renewable generation" means any kWh of electrical energy produced by the customer-owned renewable generation system that is not consumed by Customer and is delivered to the OEU electric distribution system. FMPA agrees to purchase and receive, and Customer agrees to sell and deliver, all excess customer-owned renewable generation at the energy rate established by FMPA, which shall be calculated in accordance with Schedule A. Excess customer-owned renewable generation shall be purchased in the form of a credit on Customer's monthly energy consumption bill from OEU.
- 4.03. In the event that a given monthly credit for excess customer-owned renewable generation exceeds the total billed amount for Customer's consumption in any corresponding month, then the excess credit shall be applied to the subsequent month's bill. Excess energy credits produced pursuant to the preceding sentence shall accumulate and be used to offset Customer's energy consumption bill for a period of not more than twelve (12) months. At the end of each calendar year, any unused excess energy credits shall be paid by OEU to the Customer in accordance with the OEU Electric Net-Metering Service Rate Schedule.

(Continued on Sheet No. 20.2)

Issued by: Michael Poucher, P.E. Electric Utility Director

Doc ID: 4f928bd1724124d0773eae04a05350d3eeb98c32

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 20.1)

FIRST REVISED SHEET NO. 20.2 CANCELS ORIGINAL SHEET NO. 20.2

- 4.04. FMPA and OEU shall not be required to purchase or receive excess customer-owned renewable generation, and may require Customer to interrupt or reduce production of customer-owned renewable generation, (a) when necessary in order to construct, install, maintain, repair, replace, remove, investigate, or inspect any OEU equipment or part of OEU's system; or (b) if either FMPA or OEU determine, in their sole judgment, that curtailment, interruption, or reduction is necessary because of emergencies, forced outages, force majeure, or compliance with any applicable electric code or standard.
- 4.05. Customer acknowledges that its provision of electricity to OEU hereunder is on a first-offered, first-accepted basis and subject to diminution and/or rejection in the event the total amount of electricity delivered to OEU pursuant to the Net-Metering Service Rate Schedule (as filed with the Florida Public Service Commission), from all participating OEU customers, exceeds two and one-half percent (2.5%) of the aggregate customer peak demand on the OEU electric system.

#### Section 5. Renewable Energy Credits

- 5.01. Customer shall offer FMPA a first right of refusal before selling or granting to any third party the right to the Green Attributes associated with its customer-owned renewable generation that is interconnected to OEU electric distribution system. The term "Green Attributes" shall include any and all credits, certificates, benefits, environmental attributes, emissions reductions, offsets, and allowances, however entitled, attributable to the generation of electricity from the customer-owned-renewable generation and its displacement of conventional energy generation.
- 5.02. Any additional meter(s) installed to measure total renewable electricity generated by the Customer for the purposes of measuring Green Attributes, including and renewable energy certificates (or similarly titled credits for renewable energy generated), shall be installed at the expense of the Customer, unless determined otherwise during negotiations for the sale of the Customer's credits to FMPA.

#### Section 6. Term and Termination

- 6.01. This Agreement shall become effective upon execution by all Parties, and shall remain in effect thereafter on a month-to-month basis until terminated by any Party upon thirty (30) days written notice to all other Parties.
- 6.02. This Agreement shall terminate immediately and without notice upon: (a) termination of the electric distribution service by OEU or (b) failure by Customer to comply with any of the terms and conditions of this Agreement or OEU's Standard Interconnection Agreement for Customer-Owned Renewable Generation.

(Continued on Sheet No. 20.3)

Issued by: Michael Poucher, P.E. Electric Utility Director

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 20.2)

FIRST REVISED SHEET NO. 20.3 CANCELS ORIGINAL SHEET NO. 20.3

#### Section 7. Miscellaneous Provisions

7.01. Assignment. It is understood and agreed that no party may transfer, sell, mortgage, pledge, hypothecate, convey, designate, or otherwise assign this Agreement, or any interest herein or any rights or obligations hereunder, in whole or in part, either voluntarily or by operation of law, (including, without limitation, by merger, consolidation, or otherwise), without the express written consent of the other parties (and any such attempt shall be void), which consent shall not be unreasonably withheld. Subject to the foregoing, this Agreement shall inure to the benefit of and be binding upon the parties and their respective successors and permitted assigns.

7.02 Amendment. It is understood and agreed that FMPA and OEU reserve the right, on no less than an annual basis, to change any of the terms and conditions, including pricing, in this Agreement on sixty (60) days advance written notice. FMPA and OEU may make such changes on an immediate basis in the event any applicable law, rule, regulation or court order requires them. In such event, FMPA and OEU will give Customer as much notice as reasonably possible under the circumstances.

7.03. Indemnification. To the fullest extent permitted by laws and regulations, and in return for adequate, separate consideration, Customer shall defend, indemnify, and hold harmless FMPA and OEU, their officers, directors, agents, guests, invitees, and employees from and against all claims, damages, losses to persons or property, whether direct, indirect, or consequential (including but not limited to fees and charges of attorneys, and other professionals and court and arbitration costs) arising out of, resulting from, occasioned by, or otherwise caused by the operation or misoperation of the customer-owned renewable generation, or the acts or omissions of any other person or organization directly or indirectly employed by the Customer to install, furnish, repair, replace or maintain the customer-owned renewable generation system, or anyone for whose acts any of them may be liable.

7.04. Governing Law. The validity and interpretation of this Agreement and the rights and obligations of the parties shall be governed and construed in accordance with the laws of the State of Florida without regard for any conflicts of law provisions that might cause the law of other jurisdictions to apply. All controversies, claims, or disputes arising out of or related to this Agreement or any agreement, instrument, or document contemplated hereby, shall be brought exclusively in the County or Circuit Court for Marion County, Florida, or the United States District Court sitting in Marion County, Florida, as appropriate.

(Continued on Sheet No. 20.4)

Issued by: Michael Poucher, P.E. Electric Utility Director

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 20.3)

FIRST REVISED SHEET NO. 20.4 CANCELS ORIGINAL SHEET NO. 20.4

- 7.05. <u>Enforcement of Agreement</u>. In the event that either party is required to enforce this Agreement by court proceedings or otherwise, the prevailing party shall be entitled to recover all fees and costs incurred, including reasonable attorney's fees and costs for trial, alternative dispute resolution, and/or appellate proceedings.
- 7.06. <u>Severability</u>. To the extent any provision of this Agreement is prohibited by or invalid under applicable law, such provision shall be ineffective to the extent of such prohibition or invalidity, without invalidating the remainder of such provision or the remaining provisions of this Agreement.
- 7.07. Third Party Beneficiaries and Sovereign Immunity. This Agreement is solely for the benefit of FMPA, OEU, and Customer and no right nor shall any cause of action accrue upon or by reason, to or for the benefit of any third party not a formal party to this Agreement. Nothing in this Agreement, expressed or implied, is intended or shall be construed to confer upon any person or corporation other than FMPA, OEU, or Customer, any right, remedy, or claim under or by reason of this Agreement or any of the provisions or conditions of this Agreement; and, all provisions, representations, covenants, and conditions contained in this Agreement shall inure to the sole benefit of and be binding upon FMPA, OEU, and Customer and their respective representatives, successors, and assigns. Further, no term or condition contained in this Agreement shall be construed in any way as a waiver by either FMPA or OEU of the sovereign immunity applicable to either or both of them as established by Florida Statutes, 768.28.

(Continued on Sheet No. 20.5)

Issued by: Michael Poucher, P.E.
Electric Utility Director

OCALA, FLORIDA (Continued from Sheet No. 20.4)

#### FIRST REVISED SHEET NO. 20.5 CANCELS ORIGINAL SHEET NO. 20.5

IN WITNESS WHEREOF, Customer and OEU have executed this Agreement the day and year first above written.

City of Ocala Electric Utility  By: Ken Whitehead	By:
Title: Asst. City Manager	Title: VP of IT/OT and Sys Ops
Date: 02 / 10 / 2023	Date:02 / 13 / 2023
Customer 7 By: (Print Name)	Date: 1 19 23
(Signature) Customer's City of Ocala Electric Utility	Account Number: 302809 - 201612

Approved as to form and legality:

William E. Sexton
William E. Sexton
City Attorney

(Continued on Sheet No. 20.6)

Issued by: Michael Poucher, P.E. Electric Utility Director

#### OCALA ELECTRIC UTILITY OCALA, FLORIDA

#### Tier 1 – Standard Interconnection Agreement Customer-Owned Renewable Generation System

L m

This Agreement is made and entered into this 49 day of (CM) (VVC), 2013, by and
between Knick Rollow, (hereinafter called "Customer"), located at
between Knych Rolling World, (hereinafter called "Cystomer"), located at cold 104 Cold City of Ocala doing
business as Ocala Electric Utility (hereinafter called OEU), a body politic. Customer and OEU
shall collectively be called the "Parties". The physical location/premise where the interconnection is taking place: A+ (013(0 DE 00Ch50)0) Py Vdy (Y00) Fu 300)
is taking place: H+ (01360 DE OOCHSONOTIP, Vd, (VOU, FL, SUCT)

#### WITNESSETH

Whereas, a Tier 1 Renewable Generation System (RGS) is an electric generating system that uses one or more of the following fuels or energy sources: hydrogen, biomass, solar energy, geothermal energy, wind energy, ocean energy, waste heat, or hydroelectric power as defined in Section 377.803, Florida Statutes, rated at no more than ten (10) kilowatts (10 kW) alternating current (AC) power output and is primarily intended to offset part or all of the Customer's current electric requirements; and

Whereas, OEU operates an electric system serving the City of Ocala; and

Whereas, Customer has made a written Application to OEU, a copy being attached hereto, to interconnect its RGS with OEU' electrical supply grid at the location identified above; and

Whereas, the City of Ocala and the Florida Municipal Power Agency (hereinafter called "FMPA") have entered into the All-Requirements Power Supply Contract pursuant to which the City of Ocala has agreed to purchase and receive, and FMPA has agreed to sell and supply OEU with all energy and capacity necessary to operate the OEU electric system, which limits OEU' ability to directly purchase excess energy from customer-owned renewable generation; and

Whereas, in order to promote the development of small customer-owned renewable generation by permitting OEU to allow its customers to interconnect with OEU's electric system and to allow OEU customers to offset their electric consumption with customer-owned renewable generation, FMPA, in accordance with the terms and conditions of this agreement, has agreed to purchase excess customer-owned generation from OEU customers interconnected to OEU's electric system; and

Whereas, the OEU desires to provide interconnection of a RGS under conditions which will insure the safety of OEU customers and employees, reliability and integrity of its distribution system;

NOW, THEREFORE, for and in consideration of the mutual covenants and agreements herein set forth, the parties hereto covenant and agree as follows:

(Continued on Sheet No. 21.1)

Issued by: Michael Poucher, P.E. Electric Utility Director

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 21.0)

FIRST REVISED SHEET NO. 21.1 CANCELS ORIGINAL SHEET NO. 21.1

- 1. The Customer shall be required to enter into a Tri-Party Net-Metering Purchase Power Agreement with FMPA and the City of Ocala Electric Utility (OEU).
- 2. "Gross power rating" (GPR) means the total manufacturer's AC nameplate generating capacity of an on-site customer-owned renewable generation system that will be interconnected to and operate in parallel with OEU's distribution facilities. For inverter-based systems, the GPR shall be calculated by multiplying the total installed DC nameplate generating capacity by 0.85 in order to account for losses during the conversion from DC to AC.
- 3. This agreement is strictly limited to cover a Tier 1 RGS as defined above. It is the Customer's responsibility to notify OEU of any change to the GPR of the RGS by submitting a new application for interconnection specifying the modifications at least 30 days prior to making the modifications. Increase in GPR above the ten kilowatt (10 kW) limit would necessitate entering into a new agreement at either Tier 2 or Tier 3 which may impose additional requirements on the Customer. In no case does the Tier 1, Tier 2 or Tier 3 agreement cover increases in GPR above two megawatts (2MW).
- 4. The RGS GPR must not exceed 90 percent (90%) of the Customer's OEU calculated distribution service rating at the Customer's location (including shared electric facilities). If the GPR does exceed the 90 percent (90%) limit, the Customer shall be responsible to pay the cost of upgrades to the distribution facilities required to accommodate the GPR capacity and ensure the 90 percent (90%) threshold is not breached. OEU will not allow a RGS GPR greater than required to offset the customer's annual kWh energy consumption (based on customer's historical consumption data or by means of estimated usage of similar type of service as determined by OEU).
- 5. The Customer shall not be required to pay any special fees due solely to the installation of the RGS.
- 6. The Customer shall fully comply with OEU's Design Standards following NEC standards as those documents may be amended or revised by OUS from time to time.
- 7. The Customer certifies that its installation, its operation and its maintenance shall be in compliance with the following standards (or most current version at time of inspection approval):
  - a. IEEE-1547 (2018) Standard for Interconnecting Distributed Resources with Electric Power System;
  - b. IEEE-1547.1 (2005) Standard Conformance Test Procedures for Equipment Interconnection Distributed Resources with Electric Power Systems;
  - c. UL-1741 (2010) Inverters, Converters, Controllers and Interconnection System Equipment for Use with Distributed *Energy Resources*.
  - d. The National Electric Code, state and/or local building codes, mechanical codes and/or electrical codes;
  - e. The manufacturer's installation, operation and maintenance instructions.

(Continued to Sheet No. 21.2)

Issued by: Michael Poucher, P.E. Electric Utility Director

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 21.1)

#### FIRST REVISED SHEET NO. 21.2 CANCELS ORIGINAL SHEET NO. 21.2

- 8. The Customer is not precluded from contracting for the lease, operation or maintenance of the RGS with a third party. Such lease may not provide terms or conditions that provide for any payments under the agreement to any way indicate or reflect the purchase of energy produced by the RGS. Customer shall not enter into any lease agreement that results in the retail purchase of electricity; or the retail sale of electricity from the customer-owned renewable generation. Notwithstanding this restriction, in the event that Customer is determined to have engaged in the retail purchase of electricity from a party other than OEU, then Customer shall be in breach of this Agreement and may be subject to the jurisdiction of the Florida Public Service Commission and to fines/penalties.
- 9. The Customer shall provide a copy of the manufacturer's installation, operation and maintenance instructions to OEU. If the RGS is leased to the Customer by a third party, or if the operation or maintenance of the RGS is to be performed by a third party, the lease and/or maintenance agreements and any pertinent documents related to these agreements shall be provided to OEU.
- 10. Prior to commencing parallel operation with OEU's electric system, Customer shall have the RGS inspected and approved by the appropriate code authorities having jurisdiction. Customer shall provide a copy of this inspection and approval to OEU.
- 11. The Customer agrees to permit OEU, if it should so choose, to inspect the RGS and its component equipment and the documents necessary to ensure compliance with this Agreement both before and after the RGS goes into service and to witness the initial testing of the RGS equipment and protective apparatus. OEU will provide Customer with as much notice as reasonably possible, either in writing, email, facsimile or by phone as to when OEU may conduct inspections and or document review. Upon reasonable notice, or at any time without notice in the event of an emergency or hazardous condition, Customer agrees to provide OEU access to the Customer's premises for any purpose in connection with the performance of the obligations required by this Agreement or, if necessary, to meet OEU's legal obligation to provide service to its customers. At least ten (10) business days prior to initially placing the customer-owned renewable generation system in service, Customer shall provide written notification to OEU advising of the date and time at which Customer intends to place the system in service, and OEU shall have the right to have personnel present on the in-service date in order to ensure compliance with the requirements of this Agreement.

(Continued on Sheet No. 21.3)

Issued by: Michael Poucher, P.E. Electric Utility Director

OCALA, FLORIDA (Continued from Sheet No. 21.2) FIRST REVISED SHEET NO. 21.3 CANCELS ORIGINAL SHEET NO. 21.3

- 12. The Customer's RGS must have an appropriately sized grid-tie inverter system that includes applicable protective systems. Customer certifies that the RGS equipment includes an OEU interactive inverter or interconnection system equipment that ceases to interconnect with the OEU system upon a loss of OEU's electric power. The inverter shall be considered certified for interconnected operation if it has been submitted by a manufacturer to a nationally recognized testing laboratory (NRTL) to comply with UL 1741. The NRTL shall be approved by the Occupational Safety & Health Administration (OSHA).
- 13. If Customer adds another RGS that (i) utilizes the same OEU interactive inverter for both systems, or (ii) utilizes a separate OEU interactive inverter for each system, Customer shall provide OEU with sixty (60) days advance written notice of the addition.
- 14. The Customer shall not energize the OEU system when OEU's system is deenergized. The Customer shall cease to energize the OEU system during a faulted condition on the OEU system and/or upon any notice from OEU that the deenergizing of Customer's RGS equipment is necessary. The Customer shall cease to energize the OEU system prior to automatic or non-automatic reclosing of OEU's protective devices. There shall be no intentional islanding, as described in IEEE 1547, between the Customer's and OEU' systems.
- 15. The Customer is responsible for the protection of its generation equipment, inverters, protection devices, and other system components from damage from the normal and abnormal operations that occur on OEU system in delivering and restoring system power. Customer agrees that any damage to any of its property, including, without limitation, all components and related accessories of its RGS system, due to the normal or abnormal operation of OEU system, is at Customer's sole risk and expense. Customer is also responsible for ensuring that the customer-owned renewable generation equipment is inspected, maintained, and tested regularly in accordance with the manufacturer's instructions to ensure that it is operating correctly and safely.
- 16. The Customer must install, at their expense, a manual disconnect switch of the visible load break type to provide a separation point between the AC power output of the customer-owned renewable generation system and any Customer wiring connected to OEU's system, such that back feed from the customer-owned renewable generation system to OEU's system cannot occur when the switch is in the open position. The manual disconnect switch shall be mounted separate from the meter socket on an exterior surface adjacent to the meter. The switch shall be readily accessible to OEU and capable of being locked in the open position with an OEU padlock. When locked and tagged in the open position by OEU, this switch will be under the control of OEU.

(Continued on Sheet No. 21.4)

Issued by: Michael Poucher, P.E. Electric Utility Director

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 21.3)

FIRST REVISED SHEET NO. 21.4 CANCELS ORIGINAL SHEET NO. 21.4

- 17. Subject to an approved inspection, including installation of acceptable disconnect switch, this Agreement shall be executed by OEU within thirty (30) calendar days of receipt of a completed application. Customer must execute this Agreement and return it to OEU at least thirty (30) calendar days prior to beginning parallel operations with OEU's electric system, subject to the requirements of Section 18, below, and within one (1) year after OEU executes this Agreement.
- 18. Once OEU has received Customer's written documentation that the requirements of this Agreement have been met, all agreements and documentation have been received and the correct operation of the manual switch has been demonstrated to an OEU representative, OEU will, within fifteen (15) business days, send written notice that parallel operation of the RGS may commence.
- 19. OEU requires the Customer to maintain general liability insurance for personal injury and property damage in the amount of not less than one hundred thousand dollars (\$100,000.00).
- 20. OEU will furnish, install, own and maintain metering equipment capable of measuring the flow of kilowatt-hours (kWh) of energy. The Customer's service associated with the RGS will be metered to measure the energy delivered by OEU to Customer, and measure the energy delivered by Customer to OEU. Customer agrees to provide safe and reasonable access to the premises for installation, maintenance and reading of the metering and related equipment. The Customer shall not be responsible for the cost of the installation and maintenance of the metering equipment necessary to measure the energy delivered by the Customer to OEU.
- 21. The Customer shall be solely responsible for all legal and financial obligations arising from the design, construction, installation, operation, maintenance and ownership of the RGS.
- 22. The Customer must obtain all permits, inspections and approvals required by applicable jurisdictions with respect to the generating system and must use a licensed, bonded and insured contractor to design and install the generating system. The Customer agrees to provide OEU with a copy of the local building code official inspection and certification of installation. The certification shall reflect that the local code official has inspected and certified that the installation was permitted, has been approved, and has met all electrical and mechanical qualifications.

(Continued on Sheet No. 21.5)

Issued by: Michael Poucher, P.E.

Electric Utility Director

FIRST REVISED SHEET NO. 21.5 CANCELS ORIGINAL SHEET NO. 21.5

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 21.4)

- 23. In no event shall any statement, representation, or lack thereof, either express or implied, by OEU, relieve the Customer of exclusive responsibility for the Customer's system. Specifically, any OEU inspection of the RGS shall not be construed as confirming or endorsing the system design or its operating or maintenance procedures or as a warranty or guarantee as to the safety, reliability, or durability of the RGS. OEU's inspection, acceptance, or its failure to inspect shall not be deemed an endorsement of any RGS equipment or procedure. Further, as set forth in Sections 15 and 26 of this Agreement, Customer shall remain solely responsible for any and all losses, claims, damages and/or expenses related in any way to the operation or misoperation of its RGS equipment.
- 24. Notwithstanding any other provision of this Interconnection Agreement, OEU, at its sole and absolute discretion, may isolate the Customer's system from the distribution grid by whatever means necessary, without prior notice to the Customer. To the extent practical, however, prior notice shall be given. The system will be reconnected as soon as practical once the conditions causing the disconnection cease to exist. OEU shall have no obligation to compensate the Customer for any loss of energy during any and all periods when Customer's RGS is operating at reduced capacity or is disconnected from OEU' electrical distribution system pursuant to this Interconnection Agreement. Typical conditions which may require the disconnection of the Customer's system include, but are not limited to, the following:
  - a. OEU system emergencies, forced outages, uncontrollable forces or compliance with prudent electric OEU practice.
  - b. When necessary to investigate, inspect, construct, install, maintain, repair, replace or remove any OEU equipment, any part of OEU's electrical distribution system or Customer's generating system.
  - c. Hazardous conditions existing on OEU's system due to the operation of the Customer's generation or protective equipment as determined by OEU.
  - d. Adverse electrical affects (such as power quality problems) on the electrical equipment of OEU's other electric consumers caused by the Customer's generation as determined by OEU.
  - e. When Customer is in breach of any of its obligations under this Interconnection Agreement or any other applicable policies and procedures of OEU.
  - f. When the Customer fails to make any payments due to OEU by the due date thereof.
- 25. Upon termination of services pursuant to this Agreement, OEU shall open and padlock the manual disconnect switch and remove any additional metering equipment related to this Agreement. At the Customer's expense, within thirty (30) working days following the termination, the Customer shall permanently isolate the RGS and any associated equipment from OEU's electric supply system, notify OEU that the isolation is complete, and coordinate with OEU for return of OEU's lock.

(Continued to Sheet No. 21.6)

Issued by: Michael Poucher, P.E. Electric Utility Director

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 21.5)

FIRST REVISED SHEET NO. 21.6 CANCELS ORIGINAL SHEET NO. 21.6

- 26. To the fullest extent permitted by law, and in return for adequate, separate consideration, Customer shall indemnify, defend and hold harmless OEU, any and all of their members of its governing bodies, and its officers, agents, and employees for, from and against any and all claims, demands, suits, costs of defense, attorneys fees, witness fees of any type, losses, damages, expenses, and liabilities, whether direct, indirect or consequential, related to, arising from, or in any way connected with:
  - a. Customer's design, construction, installation, inspection, maintenance, testing or operation of Customer's generating system or equipment used in connection with this Interconnection Agreement, irrespective of any fault on the part of OEU.
  - b. The interconnection of Customer's generating system with, and delivery of energy from the generating system to, OEU's electrical distribution system, irrespective of any fault on the part of OEU.
  - c. The performance or nonperformance of Customer's obligations under this Interconnection Agreement or the obligations of any and all of the members of Customer's governing bodies and its officers, agents, contractors (and any subcontractor or material supplier thereof) and employees.

Customer's obligations under this Section shall survive the termination of this Interconnection Agreement.

- 27. Customer shall not have the right to assign its benefits or obligations under this Agreement without OEU's prior written consent and such consent shall not be unreasonably withheld. If there is a change in ownership of the RGS, Customer shall provide written notice to OEU at least thirty (30) days prior to the change in ownership. The new owner will be required to assume, in writing, the Customer's rights and duties under this Agreement, or execute a new Standard Interconnection Agreement. The new owner shall not be permitted to net meter or begin parallel operations until the new owner assumes this Agreement or executes a new Agreement.
- 28. This Agreement supersedes all previous agreements and representations either written or verbal heretofore made between OEU and Customer with respect to matters herein contained. This Agreement, when duly executed, constitutes the only Agreement between parties hereto relative to the matters herein described. This Agreement shall continue in effect from year to year until either party gives sixty (60) days' notice of its intent to terminate this Agreement.

(Continued on Sheet No. 21.7)

Issued by: Michael Poucher, P.E.
Electric Utility Director

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 21.6)

FIRST REVISED SHEET NO. 21.7 CANCELS ORIGINAL SHEET NO. 21.7

29. This Agreement shall be governed by and construed and enforced in accordance with the laws, rules and regulations of the State of Florida and OEU's tariff as it may be modified, changed, or amended from time to time, including any amendments modification or changes to OEU's Net-Metering Service Rate Schedule, the schedule applicable to this Agreement. The Customer and OEU agree that any action, suit, or proceeding arising out of or relating to this Interconnection Agreement shall be initiated and prosecuted in the state court of competent jurisdiction located in Marion County, Florida, and OEU and the Customer irrevocably submit to the jurisdiction and venue of such court. To the fullest extent permitted by law, each Party hereby irrevocably waives any and all rights to a trial by jury and covenants and agrees that it will not request a trial by jury with respect to any legal proceeding arising out of or relating to this Interconnection Agreement.

None of the provisions of this Interconnection Agreement shall be considered waived by either Party except when such waiver is given in writing. No waiver by either Party of any one or more defaults in the performance of the provisions of this Interconnection Agreement shall operate or be construed as a waiver of any other existing or future default or defaults. If any one or more of the provisions of this Interconnection Agreement or the applicability of any provision to a specific situation is held invalid or unenforceable, the provision shall be modified to the minimum extent necessary to make it or its application valid and enforceable, and the validity and enforceability of all other provisions of this Interconnection Agreement and all other applications of such provisions shall not be affected by any such invalidity or unenforceability. This Interconnection Agreement does not govern the terms and conditions for the delivery of power and energy to non-generating retail customers of OEU's electrical distribution system.

- 30. This Agreement incorporates by reference the terms of the tariff filed with the Florida Public Service Commission by OEU, including OEU's Net-Metering Service Rate Schedule, and associated technical terms and abbreviations, general rules and regulations and standard electric service requirements (as may be applicable) are incorporated by reference, as amended from time to time. To the extent of any conflict between this Agreement and such tariff, the tariff shall control
- 31. OEU and Customer recognize that the Florida Statutes and/or the Florida Public Service Commission Rules, including those directly addressing the subject of this Agreement, may be amended from time to time. In the event that such statutes and/or rules are amended that affect the terms and conditions of this Agreement, OEU and Customer agree to supersede and replace this Agreement with a new Interconnection Agreement, which complies with the amended statutes/rules.

(Continued on Sheet No. 21.8)

Issued by: Michael Poucher, P.E. Electric Utility Director

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 21.7)

FIRST REVISED SHEET NO. 21.8 CANCELS ORIGINAL SHEET NO. 21.8

- 32. Customer acknowledges that its provision of electricity to OEU hereunder is on a first-offered, first-accepted basis and subject to diminution and/or rejection in the event the total amount of electricity delivered to OEU pursuant to the OEU's Net-Metering Service Rate Schedule, (as filed with the Florida Public Service Commission), from all participating OEU customers, exceeds two and one-half percent (2.5%) of the aggregate customer peak demand on the OEU system.
- 33. This Agreement is solely for the benefit of OEU and Customer and no right nor any cause of action shall accrue upon or by reason, to or for the benefit of any third party not a formal party to this Agreement. Nothing in this Agreement, expressed or implied, is intended or shall be construed to confer upon any person or corporation other than OEU or Customer, any right, remedy, or claim under or by reason of this Agreement or any of the provisions or conditions of this Agreement; and, all provisions, representations, covenants, and conditions contained in this Agreement shall inure to the sole benefit of and be binding upon OEU and Customer and their respective representatives, successors, and assigns. Further, no term or condition contained in this Agreement shall be construed in any way as a waiver by OEU of the sovereign immunity applicable to OEU as established by Florida Statutes, 768.28.

(Continued on Sheet No. 21.9)

Issued by: Michael Poucher, P.E. Electric Utility Director

#### OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 21.8)

#### FIRST REVISED SHEET NO. 21.9 CANCELS ORIGINAL SHEET NO. 21.9

IN WITNESS WHEREOF, Customer and OEU have executed this Agreement the day and year first above written.

City of Ocala Electric Utility:	Customer:
By: Ken Whitehead	By: Bit Can Baixed (Print Name)
Title: Asst. City Manager	(Signature)
Date:02 / 10 / 2023	Date: 1110117033
	City of Ocala Electric Utility Account Number
	Starra-Roma autola

Approved as to form and legality:

William E. Sexton
William E. Sexton
City Attorney

Issued by: Michael Poucher, P.E. Electric Utility Director

OCALA ELECTRIC UTILITY OCALA, FLORIDA (Continued from Sheet No. 20.5)

FIRST REVISED SHEET NO. 20.6 CANCELS ORIGINAL SHEET NO. 20.6

#### Tri-Party Net-Metering Power Purchase Agreement Schedule A

#### I. All-Requirements Project Calculation of Excess Customer-Owned Renewable Generation Credit

a) FMPA shall pay OEU for the excess kWh energy delivered by customer-owned renewable generation to OEU's electric system. Every month, OEU shall determine the total kWh of customer-owned renewable generation that is delivered to OEU's electric system, and shall send the information to FMPA as soon as it becomes available, but no later than the second working day of every month. FMPA will then provide a monthly payment to OEU in the form of a credit on the ARP power bill for the excess energy delivered to the distribution grid. The ARP Renewable Generation Credit will be calculated as follows:

ARP Renewable Generation Credit = Quarterly Energy Rate \* Monthly kWh of excess customer-owned renewable generation

Quarterly Energy Rate = 3 month average of ARP energy rate. FMPA will update the Quarterly Energy Rate every April 1, July 1, October 1 and January 1.

b) As part of the monthly bill adjustment, FMPA will also increase OEU's kWh billing amount by the same kWh amount as the customer-owned renewable generation purchased by FMPA. This adjustment is necessary because excess customer generation that flows onto OEU's electric system has been purchased by FMPA, but will remain on OEU's electric system and be used by OEU to meet its other customers' electric needs. As a result, OEU's monthly ARP bill will be adjusted accordingly to reflect FMPA's subsequent sale of this energy to OEU.

#### II. Payment for Unused Excess Energy Credits

- a) Monthly excess energy credits shall accumulate and be used to offset the Customer's following month energy consumption bill for a period of not more than twelve (12) months.
- b) At the end of each calendar year, OEU shall pay the Customer for any unused excess energy credits in accordance with the OEU Electric Net-Metering Service Rate Schedule.

Issued by: Michael Poucher, P.E. Electric Utility Director



Title FOR SIGNATURES - Application for Interconnection of.....

File name #230210\_Bryan Baker.pdf

Document ID 4f928bd1724124d0773eae04a05350d3eeb98c32

Audit trail date format MM / DD / YYYY

Status • Signed

#### **Document History**

()	01 / 24 / 2023	Sent for signature to William E. Sexton
SENT	15:42:40 UTC-5	(wsexton@ocalafl.org), Ken Whitehead

(kwhitehead@ocalafl.org) and Florida Municipal Power Agency

(chris.gowder@fmpa.com) from slewis@ocalafl.org

IP: 216.255.240.104

$\odot$	02 / 01 / 2023	Viewed by William E. Sexton (wsexton@ocalafl.org)
VIEWED	13:17:13 UTC-5	IP: 216.255.240.104

r	02 / 01 / 2023	Signed by William E. Sexton (wsexton@ocalafl.org)
SIGNED	13:18:15 UTC-5	IP: 216.255.240.104

$\odot$	02 / 01 / 2023	Viewed by Ken Whitehead (kwhitehead@ocalafl.org)
VIEWED	17:55:06 UTC-5	IP: 216.255.240.104

p	02 / 10 / 2023	Signed by Ken Whitehead (kwhitehead@ocalafl.org)
SIGNED	17:34:49 UTC-5	IP: 216.255.240.104



Title FOR SIGNATURES - Application for Interconnection of......

File name #230210\_Bryan Baker.pdf

Document ID 4f928bd1724124d0773eae04a05350d3eeb98c32

Audit trail date format MM / DD / YYYY

Status • Signed

#### **Document History**

O2 / 13 / 2023 Viewed by Florida Municipal Power Agency

VIEWED 08:26:39 UTC-5 (chris.gowder@fmpa.com)

IP: 38.77.131.2

<u>▶</u> 02 / 13 / 2023 Signed by Florida Municipal Power Agency

SIGNED 08:26:48 UTC-5 (chris.gowder@fmpa.com)

IP: 38.77.131.2

7 02 / 13 / 2023 The document has been completed.

COMPLETED 08:26:48 UTC-5