

230251

OCALA ELECTRIC UTILITY
OCALA, FLORIDA

FIRST REVISED SHEET NO. 19.0
CANCELS ORIGINAL SHEET NO. 19.0

**APPLICATION FOR INTERCONNECTION OF
CUSTOMER-OWNED RENEWABLE
GENERATION SYSTEMS**

TIER 1 - Ten (10) kW or Less

TIER 2 - Greater than 10 kW and Less Than or Equal to 100 kW

TIER 3 - Greater than 100 kW and Less Than or Equal to Two (2) MW

Note: These customer-owned renewable generation system size limits may be subject to a cumulative enrollment limit on net-metering customers located in the area served by the City of Ocala Electric Utility. Please refer to the Ocala Electric Utility Net-Metering Rate Schedule.

Ocala Electric Utility customers who install customer-owned renewable generation systems (RGS) and desire to interconnect those facilities with the Ocala Electric Utility system are required to complete this application. When the completed application and fees are returned to Ocala Electric Utility, the process of completing the appropriate Tier 1, Tier 2 or Tier 3 Interconnection Agreement can begin. This application and copies of the Interconnection Agreements may be obtained at Ocala Electric Utility, located at 201 SE 3rd Street, Ocala, Florida 34471, or may be requested by email from OEU@ocalafl.org.

1. Customer Information

Name: Jane Woodgerd
Mailing Address: 2715 SE 29th Street
City: Ocala State: FL Zip Code: 34471
Phone Number: 352-427-4438 Alternate Phone Number: 352-300-5001
Email Address: chiefagleceo@gmail.com Fax Number: 352-309-2814
Ocala Electric Utility Customer Account Number: 528795-11146

2. RGS Facility Information

Facility Location: 2715 SE 29th Street Ocala, FL 34471
Ocala Electric Utility Customer Account Number: 528795151146
RGS Manufacturer: LG LG380N1C-A6 : Enphase IQ7PLUS-72-2-US
Manufacturer's Address: _____
Reference or Model Number: LG LG380N1C-A6 : Enphase IQ7PLUS-72-2-US
Serial Number: _____

(Continued on Sheet No.19.1)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

OCALA ELECTRIC UTILITY
OCALA, FLORIDA
(Continue from Sheet No. 19.0)

FIRST REVISED SHEET NO. 19.1
CANCELS ORIGINAL SHEET NO. 19.1

3. Facility Rating Information

Gross Power Rating: 11.6 ^{9.86 AC} ("Gross power rating" means the total manufacturer's AC nameplate generating capacity of an on-site customer-owned renewable generation system that will be interconnected to and operate in parallel with Ocala Electric Utility's distribution facilities. For inverter-based systems, the AC nameplate generating capacity shall be calculated by multiplying the total installed DC nameplate generating capacity by 0.85 in order to account for losses during the conversion from DC to AC.)

Fuel or Energy Source: Solar

Anticipated In- Service Date: TBD

4. Application Fee

The application fee is based on the Gross Power Rating and must be submitted with this application. The non-refundable application fee is \$375 for Tier 2 and \$750 for Tier 3 installations. There is no application fee for Tier 1 installations.

5. Interconnection Study Fee

For Tier 3 installations, a deposit in the amount of the estimated costs of the study (to be determined at time of application) must be paid along with this application in addition to the application fee referenced in Article 4 above. This deposit will be applied toward the cost of an interconnection study. The customer will be responsible for the actual costs of the study. Should the actual cost of the study be less than the deposit, the difference will be refunded to the customer. Customer agrees to comply with all interconnection requirements identified in the interconnection study report.

6. Required Documentation

Prior to completion of the Interconnection Agreement, the following information must be provided to the Ocala Electric Utility by the customer.

- A. Documentation demonstrating that the installation complies with (or most current version at time of inspection approval):
1. IEEE 1547 (2018) Standard for Interconnecting Distributed Resources with Electric Power Systems.
 2. IEEE 1547.1 (2005) Standard Conformance Test Procedures for Equipment Interconnecting Distributed Resources with Electric Power Systems.
 3. UL 1741 (2010) Inverters, Converters, Controllers and Interconnection System Equipment for Use with Distributed Energy Resources.

(Continued on Sheet No. 19.2)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

Ocala Electric Utility
Ocala, Florida
(Continued from Sheet No. 19.1)

FIRST REVISED SHEET NO. 19.2
CANCELS ORIGINAL SHEET NO. 19.2

B. Documentation that the customer-owned renewable generation has been inspected and approved by local code officials prior to its operation in parallel with the Ocala Electric Utility system to ensure compliance with applicable local codes. OEU will also require proof of commission testing by a qualified 3rd party testing company (not affiliated in any way with the manufacturer, vendor or installation contractor), for compliance with all required and applicable codes, standards, and interconnection study requirements, prior to setting of OEU metering equipment.

C. Proof of insurance in the amount of:

Tier 1 - \$100,000.00
Tier 2 - \$1,000,000.00
Tier 3 - \$2,000,000.00

Customer

By: Steve Woodgerd Date: 3/1/22
(Print Name)

[Signature]
(Signature)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

EXCESS COMPREHENSIVE PERSONAL LIABILITY COVERAGE DECLARATIONS**Policy No. XPL2602184**Effective Date: 02/10/2022
12:01 AM STANDARD TIME**LIMITS OF INSURANCE**

Company's Limits of Insurance	\$700,000
Underlying Limits of Insurance	\$300,000

SELF INSURED RETENTION	\$0
-------------------------------	------------

LOCATION OF COVERAGE

<i>Location</i>	<i>Address</i>
1	2715 29th Street, Ocala, FL 34471

SCHEDULE OF UNDERLYING INSURANCE ATTACHED

Coverage Form(s)/Part(s) and Endorsement(s) made a part of this policy at time of issue:

See Form EOD (01/95)

THESE DECLARATIONS ARE PART OF THE POLICY DECLARATIONS CONTAINING THE NAME OF THE INSURED AND THE POLICY PERIOD.

CONTRACTOR

SUNPRO

22171 MCH RD

MANDEVILLE, LA 70471

PHONE: 9152011490

PROJECT NAME & ADDRESS

CATHERN ARNETT

2715

SE 29TH STREET,

OCALA,

FL 34471

COUNTY-MARION COUNTY

SYSTEM SIZE

DC SIZE: 15,200 KW DC-(STC)

AC SIZE: 12,920 KW AC

SHEET TITLE

RESOURCE

DOCUMENT

DRAWN DATE

2/9/2022

DRAWN BY

AP

SHEET NUMBER

R-011

POWER WALL

Backdoor Gateway 2

Power Wall is a fully integrated AC/DC battery system for residential and light commercial use. It is designed to be installed in a garage or other indoor space. The system is made up of two main components: the Power Wall unit and the Backdoor Gateway 2. The Power Wall unit is a large, black, rectangular unit that is mounted on a wall. The Backdoor Gateway 2 is a smaller, black, rectangular unit that is mounted on the wall next to the Power Wall unit. The system is designed to be installed in a garage or other indoor space. It is designed to be installed in a garage or other indoor space. It is designed to be installed in a garage or other indoor space.

PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)

Feed In Type

Grid Frequency

Current Rating

Maximum Input Short Circuit Current

Overcurrent Protection Device

Overvoltage Category

AC Meter

Primary Connectivity

Secondary Connectivity

User Interface

Operating Status

Start-up Transition

Modularity

Optional Internal Panelboard

Warranty

MECHANICAL SPECIFICATIONS

Dimensions

Weight

Mounting options

ENVIRONMENTAL SPECIFICATIONS

Operating Temperature

Recommended Temperature

Operating Humidity (RH)

Storage Conditions

Maximum Elevation

Environment

Enclosure Type

Ingress Rating

Wall Location Rating

Noise Level @ 1m

COMPLIANCE INFORMATION

Certifications

Grid Connection

Emissions

Environmental

Schematic

Fire Testing

POWER WALL

Backdoor Gateway 2

Power Wall is a fully integrated AC/DC battery system for residential and light commercial use. It is designed to be installed in a garage or other indoor space. The system is made up of two main components: the Power Wall unit and the Backdoor Gateway 2. The Power Wall unit is a large, black, rectangular unit that is mounted on a wall. The Backdoor Gateway 2 is a smaller, black, rectangular unit that is mounted on the wall next to the Power Wall unit. The system is designed to be installed in a garage or other indoor space. It is designed to be installed in a garage or other indoor space. It is designed to be installed in a garage or other indoor space.

PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)

Feed In Type

Grid Frequency

Current Rating

Maximum Input Short Circuit Current

Overcurrent Protection Device

Overvoltage Category

AC Meter

Primary Connectivity

Secondary Connectivity

User Interface

Operating Status

Start-up Transition

Modularity

Optional Internal Panelboard

Warranty

MECHANICAL SPECIFICATIONS

Dimensions

Weight

Mounting options

ENVIRONMENTAL SPECIFICATIONS

Operating Temperature

Recommended Temperature

Operating Humidity (RH)

Storage Conditions

Maximum Elevation

Environment

Enclosure Type

Ingress Rating

Wall Location Rating

Noise Level @ 1m

COMPLIANCE INFORMATION

Certifications

Grid Connection

Emissions

Environmental

Schematic

Fire Testing

POWERWALL

Tesla Powerwall is a fully-integrated AC battery system for residential or light commercial use. Its rechargeable lithium-ion battery pack provides energy storage for solar self-consumption, time-based control, and backup.

Powerwall's electrical interface provides a simple connection to any home or building. Its revolutionary compact design achieves market-leading energy density and is easy to install, enabling owners to quickly realize the benefits of reliable, clean power.

PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	120/240 V
Feed-In Type	Split Phase
Grid Frequency	60 Hz
Total Energy	14 kWh
Usable Energy ¹	13.5 kWh
Real Power, max continuous ²	5 kW (charge and discharge)
Real Power, peak (10 s, off-grid/backup) ²	7 kW (charge and discharge)
Apparent Power, max continuous	5.8 kVA (charge and discharge)
Apparent Power, peak (10 s, off-grid/backup)	7.2 kVA (charge and discharge)
Maximum Supply Fault Current	10 kA
Maximum Output Fault Current	32 A
Overcurrent Protection Device	30 A
Imbalance for Split-Phase Loads	100%
Power Factor Output Range	+/- 1.0 adjustable
Power Factor Range (full-rated power)	+/- 0.85
Internal Battery DC Voltage	50 V
Round Trip Efficiency ³	90%
Warranty	10 years

¹ Values provided for 25°C (77°F); 5.0 kW charge/discharge power.
² In Backup mode, grid charge powers limited to 1.35 kW.
³ AC to battery to AC, at full griding of life.


COMPLIANCE INFORMATION

Certifications	UL 1642, UL 1741, UL 1973, UL 9540, IEEE 1547, UN 38.3
Grid Connection	Worldwide Compatibility
Emissions	FCC Part 15 Class B, ICES 003
Environmental	RoHS Directive 2011/65/EU
Seismic	AC156, IEEE 693-2005 (high)



MECHANICAL SPECIFICATIONS

Dimensions	1150 mm x 755 mm x 155 mm (45.3 in x 29.7 in x 6.1 in)
Weight	125 kg (276 lbs)
Mounting options	Floor or wall mount

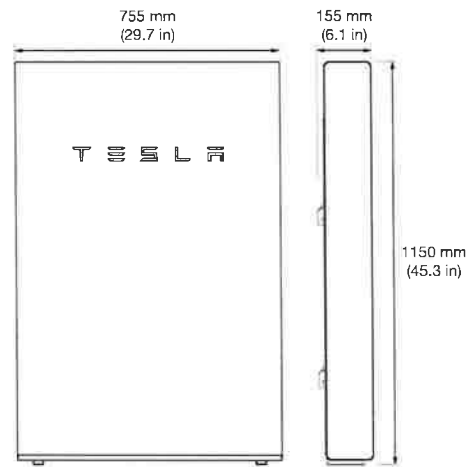


ENVIRONMENTAL SPECIFICATIONS

Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Optimum Temperature	0°C to 30°C (32°F to 86°F)
Operating Humidity (RH)	Up to 100%, condensing
Storage Conditions	-20°C to 30°C (-4°F to 86°F) Up to 95% RH, non-condensing State of Energy (SoE): 25% initial
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R
Ingress Rating	IP67 (Battery & Power Electronics) IP56 (Wiring Compartment)
Wet Location Rating	Yes
Noise Level @ 1m	< 40 dBA at 30°C (86°F)




TYPICAL SYSTEM LAYOUTS

WHOLE HOME BACKUP

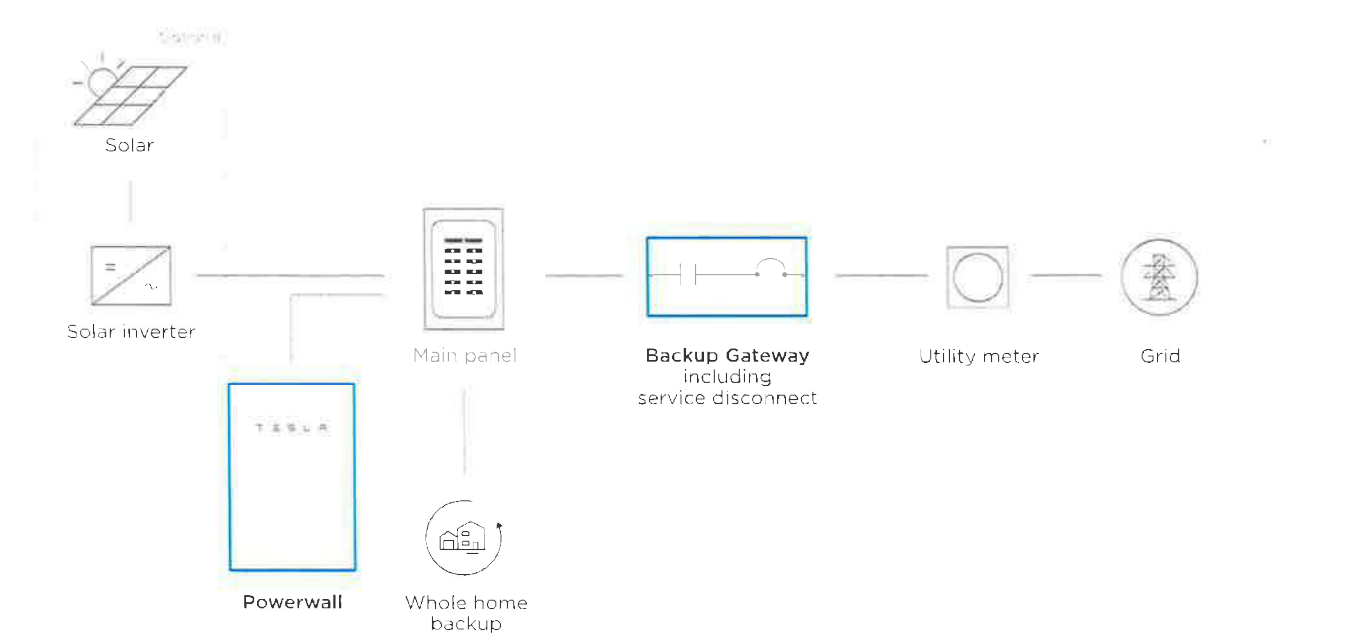

PARTIAL HOME BACKUP

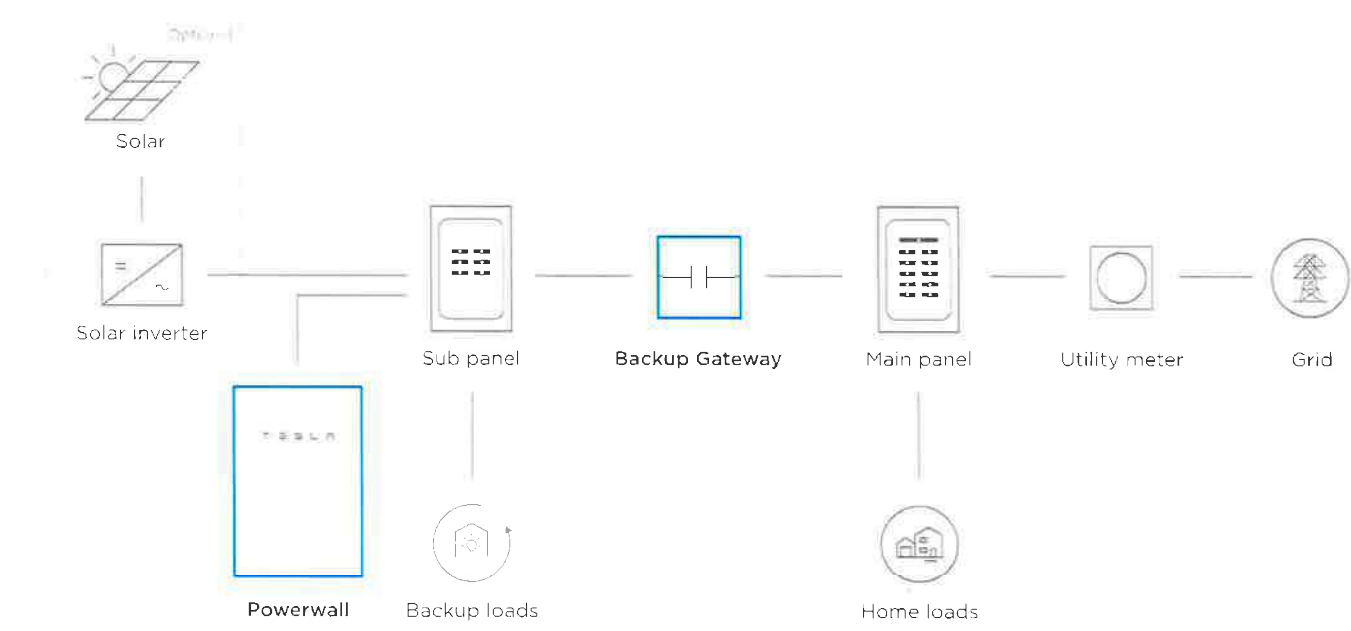

LG NeON[®] 2

LG370N1C-A6 | LG375N1C-A6 | LG380N1C-A6 Preliminary

370W | 375W | 380W

The LG NeON[®] 2 is LG's best selling solar module and one of the most powerful and versatile modules on the market today. The cells are designed to appear all black at a distance, and the performance warranty guarantees 90.6% of labeled power output at 25 years.



Features



Enhanced Performance Warranty
LG NeON[®] 2 has an enhanced performance warranty. After 25 years, LG NeON[®] 2 is guaranteed at least 90.6% of initial performance.



Solid Performance on Hot Days
LG NeON[®] 2 performs well on hot days due to its low temperature coefficient.



25 Year Limited Product Warranty
The NeON[®] 2 is covered by a 25-year limited product warranty. In addition, up to \$450 of labor will be covered in the case that a module needs to be repaired or replaced.



Roof Aesthetics
LG NeON[®] 2 has been designed with aesthetics in mind using thinner wires that appear all black at a distance.

When you go solar, ask for the brand you can trust: LG Solar

About LG Electronics USA, Inc.

LG Electronics USA, Inc. is a subsidiary of LG Electronics, Ltd. (NYSE: 066670). LG Electronics, Ltd. is a global leader in consumer electronics, mobile communications, and home appliances. LG Electronics USA, Inc. is a leading provider of solar solutions in North America. LG Solar is a part of the LG Energy Solution Group, which is a global leader in renewable energy solutions.



LG NeON[®] 2

LG370N1C-A6 | LG375N1C-A6 | LG380N1C-A6

General Data

Cell Technology (Monocrystalline)	Monocrystalline, 60 cells
Cell Architecture	60 cells (6x10)
Module Configuration	1/2 Division (2x12 cells)
Module Dimensions (L x W x H)	1654 x 992 x 30 mm
Weight	10.5 kg
Class (Material)	Tempered Glass with Anti-Reflective Coating
Backsheet (Color)	White
Frame (Material)	Anodized Aluminum
Junction Box (Protection Degree)	IP68 with 3 bypass diodes
Cable Length	1.00 m max. 2.0 m
Connector Type (Notes)	MC4, 4-pin

Certifications and Warranty

UL ENEC, IEC, TUV, CE, VDE, CSA, ISO 9001, ISO 14001, ISO 45001, ISO 50001, ISO 26001, ISO 27001, ISO 28001, ISO 29001, ISO 30001, ISO 31001, ISO 34001, ISO 35001, ISO 36001, ISO 37001, ISO 38001, ISO 39001, ISO 40001, ISO 41001, ISO 42001, ISO 43001, ISO 44001, ISO 45001, ISO 46001, ISO 47001, ISO 48001, ISO 49001, ISO 50001, ISO 51001, ISO 52001, ISO 53001, ISO 54001, ISO 55001, ISO 56001, ISO 57001, ISO 58001, ISO 59001, ISO 60001, ISO 61001, ISO 62001, ISO 63001, ISO 64001, ISO 65001, ISO 66001, ISO 67001, ISO 68001, ISO 69001, ISO 70001, ISO 71001, ISO 72001, ISO 73001, ISO 74001, ISO 75001, ISO 76001, ISO 77001, ISO 78001, ISO 79001, ISO 80001, ISO 81001, ISO 82001, ISO 83001, ISO 84001, ISO 85001, ISO 86001, ISO 87001, ISO 88001, ISO 89001, ISO 90001, ISO 91001, ISO 92001, ISO 93001, ISO 94001, ISO 95001, ISO 96001, ISO 97001, ISO 98001, ISO 99001, ISO 100001, ISO 101001, ISO 102001, ISO 103001, ISO 104001, ISO 105001, ISO 106001, ISO 107001, ISO 108001, ISO 109001, ISO 110001, ISO 111001, ISO 112001, ISO 113001, ISO 114001, ISO 115001, ISO 116001, ISO 117001, ISO 118001, ISO 119001, ISO 120001, ISO 121001, ISO 122001, ISO 123001, ISO 124001, ISO 125001, ISO 126001, ISO 127001, ISO 128001, ISO 129001, ISO 130001, ISO 131001, ISO 132001, ISO 133001, ISO 134001, ISO 135001, ISO 136001, ISO 137001, ISO 138001, ISO 139001, ISO 140001, ISO 141001, ISO 142001, ISO 143001, ISO 144001, ISO 145001, ISO 146001, ISO 147001, ISO 148001, ISO 149001, ISO 150001, ISO 151001, ISO 152001, ISO 153001, ISO 154001, ISO 155001, ISO 156001, ISO 157001, ISO 158001, ISO 159001, ISO 160001, ISO 161001, ISO 162001, ISO 163001, ISO 164001, ISO 165001, ISO 166001, ISO 167001, ISO 168001, ISO 169001, ISO 170001, ISO 171001, ISO 172001, ISO 173001, ISO 174001, ISO 175001, ISO 176001, ISO 177001, ISO 178001, ISO 179001, ISO 180001, ISO 181001, ISO 182001, ISO 183001, ISO 184001, ISO 185001, ISO 186001, ISO 187001, ISO 188001, ISO 189001, ISO 190001, ISO 191001, ISO 192001, ISO 193001, ISO 194001, ISO 195001, ISO 196001, ISO 197001, ISO 198001, ISO 199001, ISO 200001, ISO 201001, ISO 202001, ISO 203001, ISO 204001, ISO 205001, ISO 206001, ISO 207001, ISO 208001, ISO 209001, ISO 210001, ISO 211001, ISO 212001, ISO 213001, ISO 214001, ISO 215001, ISO 216001, ISO 217001, ISO 218001, ISO 219001, ISO 220001, ISO 221001, ISO 222001, ISO 223001, ISO 224001, ISO 225001, ISO 226001, ISO 227001, ISO 228001, ISO 229001, ISO 230001, ISO 231001, ISO 232001, ISO 233001, ISO 234001, ISO 235001, ISO 236001, ISO 237001, ISO 238001, ISO 239001, ISO 240001, ISO 241001, ISO 242001, ISO 243001, ISO 244001, ISO 245001, ISO 246001, ISO 247001, ISO 248001, ISO 249001, ISO 250001, ISO 251001, ISO 252001, ISO 253001, ISO 254001, ISO 255001, ISO 256001, ISO 257001, ISO 258001, ISO 259001, ISO 260001, ISO 261001, ISO 262001, ISO 263001, ISO 264001, ISO 265001, ISO 266001, ISO 267001, ISO 268001, ISO 269001, ISO 270001, ISO 271001, ISO 272001, ISO 273001, ISO 274001, ISO 275001, ISO 276001, ISO 277001, ISO 278001, ISO 279001, ISO 280001, ISO 281001, ISO 282001, ISO 283001, ISO 284001, ISO 285001, ISO 286001, ISO 287001, ISO 288001, ISO 289001, ISO 290001, ISO 291001, ISO 292001, ISO 293001, ISO 294001, ISO 295001, ISO 296001, ISO 297001, ISO 298001, ISO 299001, ISO 300001, ISO 301001, ISO 302001, ISO 303001, ISO 304001, ISO 305001, ISO 306001, ISO 307001, ISO 308001, ISO 309001, ISO 310001, ISO 311001, ISO 312001, ISO 313001, ISO 314001, ISO 315001, ISO 316001, ISO 317001, ISO 318001, ISO 319001, ISO 320001, ISO 321001, ISO 322001, ISO 323001, ISO 324001, ISO 325001, ISO 326001, ISO 327001, ISO 328001, ISO 329001, ISO 330001, ISO 331001, ISO 332001, ISO 333001, ISO 334001, ISO 335001, ISO 336001, ISO 337001, ISO 338001, ISO 339001, ISO 340001, ISO 341001, ISO 342001, ISO 343001, ISO 344001, ISO 345001, ISO 346001, ISO 347001, ISO 348001, ISO 349001, ISO 350001, ISO 351001, ISO 352001, ISO 353001, ISO 354001, ISO 355001, ISO 356001, ISO 357001, ISO 358001, ISO 359001, ISO 360001, ISO 361001, ISO 362001, ISO 363001, ISO 364001, ISO 365001, ISO 366001, ISO 367001, ISO 368001, ISO 369001, ISO 370001, ISO 371001, ISO 372001, ISO 373001, ISO 374001, ISO 375001, ISO 376001, ISO 377001, ISO 378001, ISO 379001, ISO 380001, ISO 381001, ISO 382001, ISO 383001, ISO 384001, ISO 385001, ISO 386001, ISO 387001, ISO 388001, ISO 389001, ISO 390001, ISO 391001, ISO 392001, ISO 393001, ISO 394001, ISO 395001, ISO 396001, ISO 397001, ISO 398001, ISO 399001, ISO 400001, ISO 401001, ISO 402001, ISO 403001, ISO 404001, ISO 405001, ISO 406001, ISO 407001, ISO 408001, ISO 409001, ISO 410001, ISO 411001, ISO 412001, ISO 413001, ISO 414001, ISO 415001, ISO 416001, ISO 417001, ISO 418001, ISO 419001, ISO 420001, ISO 421001, ISO 422001, ISO 423001, ISO 424001, ISO 425001, ISO 426001, ISO 427001, ISO 428001, ISO 429001, ISO 430001, ISO 431001, ISO 432001, ISO 433001, ISO 434001, ISO 435001, ISO 436001, ISO 437001, ISO 438001, ISO 439001, ISO 440001, ISO 441001, ISO 442001, ISO 443001, ISO 444001, ISO 445001, ISO 446001, ISO 447001, ISO 448001, ISO 449001, ISO 450001, ISO 451001, ISO 452001, ISO 453001, ISO 454001, ISO 455001, ISO 456001, ISO 457001, ISO 458001, ISO 459001, ISO 460001, ISO 461001, ISO 462001, ISO 463001, ISO 464001, ISO 465001, ISO 466001, ISO 467001, ISO 468001, ISO 469001, ISO 470001, ISO 471001, ISO 472001, ISO 473001, ISO 474001, ISO 475001, ISO 476001, ISO 477001, ISO 478001, ISO 479001, ISO 480001, ISO 481001, ISO 482001, ISO 483001, ISO 484001, ISO 485001, ISO 486001, ISO 487001, ISO 488001, ISO 489001, ISO 490001, ISO 491001, ISO 492001, ISO 493001, ISO 494001, ISO 495001, ISO 496001, ISO 497001, ISO 498001, ISO 499001, ISO 500001, ISO 501001, ISO 502001, ISO 503001, ISO 504001, ISO 505001, ISO 506001, ISO 507001, ISO 508001, ISO 509001, ISO 510001, ISO 511001, ISO 512001, ISO 513001, ISO 514001, ISO 515001, ISO 516001, ISO 517001, ISO 518001, ISO 519001, ISO 520001, ISO 521001, ISO 522001, ISO 523001, ISO 524001, ISO 525001, ISO 526001, ISO 527001, ISO 528001, ISO 529001, ISO 530001, ISO 531001, ISO 532001, ISO 533001, ISO 534001, ISO 535001, ISO 536001, ISO 537001, ISO 538001, ISO 539001, ISO 540001, ISO 541001, ISO 542001, ISO 543001, ISO 544001, ISO 545001, ISO 546001, ISO 547001, ISO 548001, ISO 549001, ISO 550001, ISO 551001, ISO 552001, ISO 553001, ISO 554001, ISO 555001, ISO 556001, ISO 557001, ISO 558001, ISO 559001, ISO 560001, ISO 561001, ISO 562001, ISO 563001, ISO 564001, ISO 565001, ISO 566001, ISO 567001, ISO 568001, ISO 569001, ISO 570001, ISO 571001, ISO 572001, ISO 573001, ISO 574001, ISO 575001, ISO 576001, ISO 577001, ISO 578001, ISO 579001, ISO 580001, ISO 581001, ISO 582001, ISO 583001, ISO 584001, ISO 585001, ISO 586001, ISO 587001, ISO 588001, ISO 589001, ISO 590001, ISO 591001, ISO 592001, ISO 593001, ISO 594001, ISO 595001, ISO 596001, ISO 597001, ISO 598001, ISO 599001, ISO 600001, ISO 601001, ISO 602001, ISO 603001, ISO 604001, ISO 605001, ISO 606001, ISO 607001, ISO 608001, ISO 609001, ISO 610001, ISO 611001, ISO 612001, ISO 613001, ISO 614001, ISO 615001, ISO 616001, ISO 617001, ISO 618001, ISO 619001, ISO 620001, ISO 621001, ISO 622001, ISO 623001, ISO 624001, ISO 625001, ISO 626001, ISO 627001, ISO 628001, ISO 629001, ISO 630001, ISO 631001, ISO 632001, ISO 633001, ISO 634001, ISO 635001, ISO 636001, ISO 637001, ISO 638001, ISO 639001, ISO 640001, ISO 641001, ISO 642001, ISO 643001, ISO 644001, ISO 645001, ISO 646001, ISO 647001, ISO 648001, ISO 649001, ISO 650001, ISO 651001, ISO 652001, ISO 653001, ISO 654001, ISO 655001, ISO 656001, ISO 657001, ISO 658001, ISO 659001, ISO 660001, ISO 661001, ISO 662001, ISO 663001, ISO 664001, ISO 665001, ISO 666001, ISO 667001, ISO 668001, ISO 669001, ISO 670001, ISO 671001, ISO 672001, ISO 673001, ISO 674001, ISO 675001, ISO 676001, ISO 677001, ISO 678001, ISO 679001, ISO 680001, ISO 681001, ISO 682001, ISO 683001, ISO 684001, ISO 685001, ISO 686001, ISO 687001, ISO 688001, ISO 689001, ISO 690001, ISO 691001, ISO 692001, ISO 693001, ISO 694001, ISO 695001, ISO 696001, ISO 697001, ISO 698001, ISO 699001, ISO 700001, ISO 701001, ISO 702001, ISO 703001, ISO 704001, ISO 705001, ISO 706001, ISO 707001, ISO 708001, ISO 709001, ISO 710001, ISO 711001, ISO 712001, ISO 713001, ISO 714001, ISO 715001, ISO 716001, ISO 717001, ISO 718001, ISO 719001, ISO 720001, ISO 721001, ISO 722001, ISO 723001, ISO 724001, ISO 725001, ISO 726001, ISO 727001, ISO 728001, ISO 729001, ISO 730001, ISO 731001, ISO 732001, ISO 733001, ISO 734001, ISO 735001, ISO 736001, ISO 737001, ISO 738001, ISO 739001, ISO 740001, ISO 741001, ISO 742001, ISO 743001, ISO 744001, ISO 745001, ISO 746001, ISO 747001, ISO 748001, ISO 749001, ISO 750001, ISO 751001, ISO 752001, ISO 753001, ISO 754001, ISO 755001, ISO 756001, ISO 757001, ISO 758001, ISO 759001, ISO 760001, ISO 761001, ISO 762001, ISO 763001, ISO 764001, ISO 765001, ISO 766001, ISO 767001, ISO 768001, ISO 769001, ISO 770001, ISO 771001, ISO 772001, ISO 773001, ISO 774001, ISO 775001, ISO 776001, ISO 777001, ISO 778001, ISO 779001, ISO 780001, ISO 781001, ISO 782001, ISO 783001, ISO 784001, ISO 785001, ISO 786001, ISO 787001, ISO 788001, ISO 789001, ISO 790001, ISO 791001, ISO 792001, ISO 793001, ISO 794001, ISO 795001, ISO 796001, ISO 797001, ISO 798001, ISO 799001, ISO 800001, ISO 801001, ISO 802001, ISO 803001, ISO 804001, ISO 805001, ISO 806001, ISO 807001, ISO 808001, ISO 809001, ISO 810001, ISO 811001, ISO 812001, ISO 813001, ISO 814001, ISO 815001, ISO 816001, ISO 817001, ISO 818001, ISO 819001, ISO 820001, ISO 821001, ISO 822001, ISO 823001, ISO 824001, ISO 825001, ISO 826001, ISO 827001, ISO 828001, ISO 829001, ISO 830001, ISO 831001, ISO 832001, ISO 833001, ISO 834001, ISO 835001, ISO 836001, ISO 837001, ISO 838001, ISO 839001, ISO 840001, ISO 841001, ISO 842001, ISO 843001, ISO 844001, ISO 845001, ISO 846001, ISO 847001, ISO 848001, ISO 849001, ISO 850001, ISO 851001, ISO 852001, ISO 853001, ISO 854001, ISO 855001, ISO 856001, ISO 857001, ISO 858001, ISO 859001, ISO 860001, ISO 861001, ISO 862001, ISO 863001, ISO 864001, ISO 865001, ISO 866001, ISO 867001, ISO 868001, ISO 869001, ISO 870001, ISO 871001, ISO 872001, ISO 873001, ISO 874001, ISO 875001, ISO 876001, ISO 877001, ISO 878001, ISO 879001, ISO 880001, ISO 881001, ISO 882001, ISO 883001, ISO 884001, ISO 885001, ISO 886001, ISO 887001, ISO 888001, ISO 889001, ISO 890001, ISO 891001, ISO 892001, ISO 893001, ISO 894001, ISO 895001, ISO 896001, ISO 897001, ISO 898001, ISO 899001, ISO 900001, ISO 901001, ISO 902001, ISO 903001, ISO 904001, ISO 905001, ISO 906001, ISO 907001, ISO 908001, ISO 909001, ISO 910001, ISO 911001, ISO 912001, ISO 913001, ISO 914001, ISO 915001, ISO 916001, ISO 917001, ISO 918001, ISO 919001, ISO 920001, ISO 921001, ISO 922001, ISO 923001, ISO 924001, ISO 925001, ISO 926001, ISO 927001, ISO 928001, ISO 929001, ISO 930001, ISO 931001, ISO 932001, ISO 933001, ISO 934001, ISO 935001, ISO 936001, ISO 937001, ISO 938001, ISO 939001, ISO 940001, ISO 941001, ISO 942001, ISO 943001, ISO 944001, ISO 945001, ISO 946001, ISO 947001, ISO 948001, ISO 949001, ISO 950001, ISO 951001, ISO 952001, ISO 953001, ISO 954001, ISO 955001, ISO 956001, ISO 957001, ISO 958001, ISO 959001, ISO 960001, ISO 961001, ISO 962001, ISO 963001, ISO 964001, ISO 965001, ISO 966001, ISO 967001, ISO 968001, ISO 969001, ISO 970001, ISO 971001, ISO 972001, ISO 973001, ISO 974001, ISO 975001, ISO 976001, ISO 977001, ISO 978001, ISO 979001, ISO 980001, ISO 981001, ISO 982001, ISO 983001, ISO 984001, ISO 985001, ISO 986001, ISO 987001, ISO 988001, ISO 989001, ISO 990001, ISO 991001, ISO 992001, ISO 993001, ISO 994001, ISO 995001, ISO 996001, ISO 997001, ISO 998001, ISO 999001, ISO 1000001, ISO 1001001, ISO 1002001, ISO 1003001, ISO 1004001, ISO 1005001, ISO 1006001, ISO 1007001, ISO 1008001, ISO 1009001, ISO 1010001, ISO 1011001, ISO 1012001, ISO 1013001, ISO 1014001, ISO 1015001, ISO 1016001, ISO 1017001, ISO 1018001, ISO 1019001, ISO 1020001, ISO 1021001, ISO 1022001, ISO 1023001, ISO 1024001, ISO 1025001, ISO 1026001, ISO 1027001, ISO 1028001, ISO 1029001, ISO 1030001, ISO 1031001, ISO 1032001, ISO 1033001, ISO 1034001, ISO 1035001, ISO 1036001, ISO 1037001, ISO 1038001, ISO 1039001, ISO 1040001, ISO 1041001, ISO 1042001, ISO 1043001, ISO 1044001, ISO 1045001, ISO 1046001, ISO 1047001, ISO 1048001, ISO 1049001, ISO 1050001, ISO 1051001, ISO 1052001, ISO 1053001, ISO 1054001, ISO 1055001, ISO 1056001, ISO 1057001, ISO 1058001, ISO 1059001, ISO 1060001, ISO 1061001, ISO 1062001, ISO 1063001, ISO 1064001, ISO 1065001, ISO 1066001, ISO 1067001, ISO 1068001, ISO 1069001, ISO 1070001, ISO 1071001, ISO 1072001, ISO 1073001, ISO 1074001, ISO 1075001, ISO 1076001, ISO 1077001, ISO 1078001, ISO 1079001, ISO 1080001, ISO 1081001, ISO 1082001, ISO 1083001, ISO 1084001, ISO 1085001, ISO 1086001, ISO 1087001, ISO 1088001, ISO 1089001, ISO 1090001, ISO 1091001, ISO 1092001, ISO 1093001, ISO 1094001, ISO 1095001, ISO 1096001, ISO 1097001, ISO 1098001, ISO 1099001, ISO 1100001, ISO 1101001, ISO 1102001, ISO 1103001, ISO 1104001, ISO 1105001, ISO 1106001, ISO 1107001, ISO 1108001, ISO 1109001, ISO 1110001, ISO 1111001, ISO 1112001, ISO 1113001, ISO 1114001, ISO 1115001, ISO 1116001, ISO 1117001, ISO 1118001, ISO 1119001, ISO 1120001, ISO 1121001, ISO 1122001, ISO 1123001, ISO 1124001, ISO 1125001, ISO 1126001, ISO 1127001, ISO 1128001, ISO 1129001, ISO 1130001, ISO 1131001, ISO 1132001, ISO 1133001, ISO 1134001, ISO 1135001, ISO 1136001, ISO 1137001, ISO 1138001, ISO 1139001, ISO 1140001, ISO 1141001, ISO 1142001, ISO 1143001, ISO 1144001, ISO 1145001, ISO 1146001, ISO 1147001, ISO 1148001, ISO 1149001, ISO 1150001, ISO 1151001, ISO 1152001, ISO 1153001, ISO 1154001, ISO 1155001, ISO 1156001, ISO 1157001, ISO 1158001, ISO 1159001, ISO 1160001, ISO 1161001, ISO 1162001, ISO 1163001, ISO 1164001, ISO 1165001, ISO 1166001, ISO 1167001, ISO 1168001, ISO 1169001, ISO 1170001, ISO 1171001, ISO 1172001, ISO 1173001, ISO 1174001, ISO 1175001, ISO 1176001, ISO 1177001, ISO 1178001, ISO 1179001, ISO 1180001, ISO 1181001, ISO 1182001, ISO 1183001, ISO 1184001, ISO 1185001, ISO 1186001, ISO 1187001, ISO 1188001, ISO 118900

Tri-Party Net-Metering Power Purchase Agreement

This Tri-Party Net-Metering Power Purchase Agreement (this "Agreement") is entered into this 13th day of March, 2022, by and between the Florida Municipal Power Agency, a governmental joint action agency created and existing under the laws of the State of Florida (hereinafter "FMPA"), the City of Ocala doing business as Ocala Electric Utility, a body politic (hereinafter "OEU"), and Jena M Woodyard, a retail electric customer of OEU (hereinafter "Customer").

Section 1. Recitals

1.01. OEU and Customer have executed OEU's Standard Interconnection Agreement for a Customer-Owned Renewable Generation System (RGS) pursuant to which OEU has agreed to permit interconnection of Customer's renewable generation to OEU's electric system at Customer's presently-metered location, and Customer has agreed to deliver excess electric energy generated by Customer's Renewable Generation System to OEU's electric distribution system;

1.02. The City of Ocala and FMPA have entered into the All-Requirements Power Supply Contract, dated as of May 1, 1986, (hereinafter the "ARP Contract") pursuant to which the City of Ocala has agreed to purchase and receive, and FMPA has agreed to sell and supply OEU with all energy and capacity necessary to operate the OEU electric system, which limits OEU's ability to directly purchase excess energy from customer-owned renewable generation.

1.03. In order to promote the development of small customer-owned renewable generation by permitting OEU to allow its customers to interconnect with OEU's electric system and to allow OEU's electric customers to offset their electric consumption with customer-owned renewable generation, FMPA, in accordance with the terms and conditions of this agreement, has agreed to purchase excess customer-owned generation from OEU's electric customers interconnected to OEU's electric system.

NOW THEREFORE, for and in consideration of the mutual covenants and agreements set forth herein, the Parties covenant and agree as follows:

Section 2. Interconnection

2.01. Customer shall not begin parallel operations with the OEU electric distribution system until Customer has executed OEU's electric Standard Interconnection Agreement for Small Customer-Owned Renewable Generation and is in compliance with all terms and conditions

OEU requires that the customer install and operate the RGS in accordance with all applicable safety codes and standards. OEU shall establish and enforce terms and conditions of operation and disconnection of all interconnected customer-owned renewable generation as it relates to the effect of the RGS on OEU's electric distribution system.

(Continued on Sheet No. 20.1)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

Section 3. Metering

3.01 In accordance with the OEU's Standard Interconnection Agreement for Customer-Owned Renewable Generation, OEU shall install metering equipment at the point of delivery capable of recording two separate kWh meter readings: (1) the flow of electricity from OEU to the Customer (Delivered), and (2) the flow of excess electricity from the Customer to OEU. OEU shall take meter readings on the same cycle as the otherwise applicable rate schedule.

Section 4. Purchase of Excess Customer-Owned Renewable Generation

4.01. Customer-owned renewable generation shall be first used for Customer's own load and shall offset Customer's demand for OEU's electricity. All electric power and energy delivered by OEU to Customer shall be received and paid for by Customer to OEU (Received) pursuant to the terms, conditions and rates of the OEU otherwise applicable rate schedule.

4.02. Excess customer-owned renewable generation shall be delivered to the OEU Electric distribution system. For purposes of this Agreement, the term "excess customer-owned renewable generation" means any kWh of electrical energy produced by the customer-owned renewable generation system that is not consumed by Customer and is delivered to the OEU electric distribution system. FMPA agrees to purchase and receive, and Customer agrees to sell and deliver, all excess customer-owned renewable generation at the energy rate established by FMPA, which shall be calculated in accordance with Schedule A. Excess customer-owned renewable generation shall be purchased in the form of a credit on Customer's monthly energy consumption bill from OEU.

4.03. In the event that a given monthly credit for excess customer-owned renewable generation exceeds the total billed amount for Customer's consumption in any corresponding month, then the excess credit shall be applied to the subsequent month's bill. Excess energy credits produced pursuant to the preceding sentence shall accumulate and be used to offset Customer's energy consumption bill for a period of not more than twelve (12) months. At the end of each calendar year, any unused excess energy credits shall be paid by OEU to the Customer in accordance with the OEU Electric Net-Metering Service Rate Schedule.

(Continued on Sheet No. 20.2)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

4.04. FMPA and OEU shall not be required to purchase or receive excess customer-owned renewable generation, and may require Customer to interrupt or reduce production of customer-owned renewable generation, (a) when necessary in order to construct, install, maintain, repair, replace, remove, investigate, or inspect any OEU equipment or part of OEU's system; or (b) if either FMPA or OEU determine, in their sole judgment, that curtailment, interruption, or reduction is necessary because of emergencies, forced outages, force majeure, or compliance with any applicable electric code or standard.

4.05. Customer acknowledges that its provision of electricity to OEU hereunder is on a first-offered, first-accepted basis and subject to diminution and/or rejection in the event the total amount of electricity delivered to OEU pursuant to the Net-Metering Service Rate Schedule (as filed with the Florida Public Service Commission), from all participating OEU customers, exceeds two and one-half percent (2.5%) of the aggregate customer peak demand on the OEU electric system.

Section 5. Renewable Energy Credits

5.01. Customer shall offer FMPA a first right of refusal before selling or granting to any third party the right to the Green Attributes associated with its customer-owned renewable generation that is interconnected to OEU electric distribution system. The term "Green Attributes" shall include any and all credits, certificates, benefits, environmental attributes, emissions reductions, offsets, and allowances, however entitled, attributable to the generation of electricity from the customer-owned-renewable generation and its displacement of conventional energy generation.

5.02. Any additional meter(s) installed to measure total renewable electricity generated by the Customer for the purposes of measuring Green Attributes, including and renewable energy certificates (or similarly titled credits for renewable energy generated), shall be installed at the expense of the Customer, unless determined otherwise during negotiations for the sale of the Customer's credits to FMPA.

Section 6. Term and Termination

6.01. This Agreement shall become effective upon execution by all Parties, and shall remain in effect thereafter on a month-to-month basis until terminated by any Party upon thirty (30) days written notice to all other Parties.

6.02. This Agreement shall terminate immediately and without notice upon: (a) termination of the electric distribution service by OEU or (b) failure by Customer to comply with any of the terms and conditions of this Agreement or OEU's Standard Interconnection Agreement for Customer-Owned Renewable Generation.

(Continued on Sheet No. 20.3)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

Section 7. Miscellaneous Provisions

7.01. Assignment. It is understood and agreed that no party may transfer, sell, mortgage, pledge, hypothecate, convey, designate, or otherwise assign this Agreement, or any interest herein or any rights or obligations hereunder, in whole or in part, either voluntarily or by operation of law, (including, without limitation, by merger, consolidation, or otherwise), without the express written consent of the other parties (and any such attempt shall be void), which consent shall not be unreasonably withheld. Subject to the foregoing, this Agreement shall inure to the benefit of and be binding upon the parties and their respective successors and permitted assigns.

7.02. Amendment. It is understood and agreed that FMPA and OEU reserve the right, on no less than an annual basis, to change any of the terms and conditions, including pricing, in this Agreement on sixty (60) days advance written notice. FMPA and OEU may make such changes on an immediate basis in the event any applicable law, rule, regulation or court order requires them. In such event, FMPA and OEU will give Customer as much notice as reasonably possible under the circumstances.

7.03. Indemnification. To the fullest extent permitted by laws and regulations, and in return for adequate, separate consideration, Customer shall defend, indemnify, and hold harmless FMPA and OEU, their officers, directors, agents, guests, invitees, and employees from and against all claims, damages, losses to persons or property, whether direct, indirect, or consequential (including but not limited to fees and charges of attorneys, and other professionals and court and arbitration costs) arising out of, resulting from, occasioned by, or otherwise caused by the operation or misoperation of the customer-owned renewable generation, or the acts or omissions of any other person or organization directly or indirectly employed by the Customer to install, furnish, repair, replace or maintain the customer-owned renewable generation system, or anyone for whose acts any of them may be liable.

7.04. Governing Law. The validity and interpretation of this Agreement and the rights and obligations of the parties shall be governed and construed in accordance with the laws of the State of Florida without regard for any conflicts of law provisions that might cause the law of other jurisdictions to apply. All controversies, claims, or disputes arising out of or related to this Agreement or any agreement, instrument, or document contemplated hereby, shall be brought exclusively in the County or Circuit Court for Marion County, Florida, or the United States District Court sitting in Marion County, Florida, as appropriate.

(Continued on Sheet No. 20.4)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

OCALA ELECTRIC UTILITY
OCALA, FLORIDA
(Continued from Sheet No. 20.3)

FIRST REVISED SHEET NO. 20.4
CANCELS ORIGINAL SHEET NO. 20.4

7.05. Enforcement of Agreement. In the event that either party is required to enforce this Agreement by court proceedings or otherwise, the prevailing party shall be entitled to recover all fees and costs incurred, including reasonable attorney's fees and costs for trial, alternative dispute resolution, and/or appellate proceedings.

7.06. Severability. To the extent any provision of this Agreement is prohibited by or invalid under applicable law, such provision shall be ineffective to the extent of such prohibition or invalidity, without invalidating the remainder of such provision or the remaining provisions of this Agreement.

7.07. Third Party Beneficiaries and Sovereign Immunity. This Agreement is solely for the benefit of FMPA, OEU, and Customer and no right nor shall any cause of action accrue upon or by reason, to or for the benefit of any third party not a formal party to this Agreement. Nothing in this Agreement, expressed or implied, is intended or shall be construed to confer upon any person or corporation other than FMPA, OEU, or Customer, any right, remedy, or claim under or by reason of this Agreement or any of the provisions or conditions of this Agreement; and, all provisions, representations, covenants, and conditions contained in this Agreement shall inure to the sole benefit of and be binding upon FMPA, OEU, and Customer and their respective representatives, successors, and assigns. Further, no term or condition contained in this Agreement shall be construed in any way as a waiver by either FMPA or OEU of the sovereign immunity applicable to either or both of them as established by Florida Statutes, 768.28.

(Continued on Sheet No. 20.5)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

OCALA ELECTRIC UTILITY
OCALA, FLORIDA
(Continued from Sheet No. 20.4)

FIRST REVISED SHEET NO. 20.5
CANCELS ORIGINAL SHEET NO. 20.5

IN WITNESS WHEREOF, Customer and OEU have executed this Agreement the day and year first above written.

City of Ocala Electric Utility

By: Ken Whitehead

Title: Asst. City Manager

Date: 02 / 15 / 2023

Florida Municipal Power Agency

By: [Signature]

Title: VP IT/OT and Sys Ops

Date: 02 / 15 / 2023

Customer

By: [Signature]
(Print Name)

(Signature)

Date: 3/1/22

Customer's City of Ocala Electric Utility Account Number: 528795-151146

Approved as to form and legality:

William E. Sexton

William E. Sexton
City Attorney

(Continued on Sheet No. 20.6)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

**Tri-Party Net-Metering Power Purchase Agreement
Schedule A**

I. All-Requirements Project Calculation of Excess Customer-Owned Renewable Generation Credit

- a) FMPA shall pay OEU for the excess kWh energy delivered by customer-owned renewable generation to OEU's electric system. Every month, OEU shall determine the total kWh of customer-owned renewable generation that is delivered to OEU's electric system, and shall send the information to FMPA as soon as it becomes available, but no later than the second working day of every month. FMPA will then provide a monthly payment to OEU in the form of a credit on the ARP power bill for the excess energy delivered to the distribution grid. The ARP Renewable Generation Credit will be calculated as follows:

ARP Renewable Generation Credit = Quarterly Energy Rate * Monthly kWh of excess customer-owned renewable generation

Quarterly Energy Rate = 3 month average of ARP energy rate. FMPA will update the Quarterly Energy Rate every April 1, July 1, October 1 and January 1.

- b) As part of the monthly bill adjustment, FMPA will also increase OEU's kWh billing amount by the same kWh amount as the customer-owned renewable generation purchased by FMPA. This adjustment is necessary because excess customer generation that flows onto OEU's electric system has been purchased by FMPA, but will remain on OEU's electric system and be used by OEU to meet its other customers' electric needs. As a result, OEU's monthly ARP bill will be adjusted accordingly to reflect FMPA's subsequent sale of this energy to OEU.

II. Payment for Unused Excess Energy Credits

- a) Monthly excess energy credits shall accumulate and be used to offset the Customer's following month energy consumption bill for a period of not more than twelve (12) months.
- b) At the end of each calendar year, OEU shall pay the Customer for any unused excess energy credits in accordance with the OEU Electric Net-Metering Service Rate Schedule.

Ocala Electric Utility
Ocala, Florida

FIRST REVISED SHEET NO. 21.0
CANCELS ORIGINAL SHEET NO. 21.0

**Tier 1 – Standard Interconnection Agreement
Customer-Owned Renewable Generation System**

This Agreement is made and entered into this 1st day of March, 2022, by and between Jana Woodard, (hereinafter called "Customer"), located at 2715 SE 29th St in Ocala, Florida, and the City of Ocala doing business as Ocala Electric Utility (hereinafter called OEU), a body politic. Customer and OEU shall collectively be called the "Parties". The physical location/premise where the interconnection is taking place: 2715 SE 29th St, Ocala, FL 34471.

WITNESSETH

Whereas, a Tier 1 Renewable Generation System (RGS) is an electric generating system that uses one or more of the following fuels or energy sources: hydrogen, biomass, solar energy, geothermal energy, wind energy, ocean energy, waste heat, or hydroelectric power as defined in Section 377.803, Florida Statutes, rated at no more than ten (10) kilowatts (10 kW) alternating current (AC) power output and is primarily intended to offset part or all of the Customer's current electric requirements; and

Whereas, OEU operates an electric system serving the City of Ocala; and

Whereas, Customer has made a written Application to OEU, a copy being attached hereto, to interconnect its RGS with OEU's electrical supply grid at the location identified above; and

Whereas, the City of Ocala and the Florida Municipal Power Agency (hereinafter called "FMPA") have entered into the All-Requirements Power Supply Contract pursuant to which the City of Ocala has agreed to purchase and receive, and FMPA has agreed to sell and supply OEU with all energy and capacity necessary to operate the OEU electric system, which limits OEU's ability to directly purchase excess energy from customer-owned renewable generation; and

Whereas, in order to promote the development of small customer-owned renewable generation by permitting OEU to allow its customers to interconnect with OEU's electric system and to allow OEU customers to offset their electric consumption with customer-owned renewable generation, FMPA, in accordance with the terms and conditions of this agreement, has agreed to purchase excess customer-owned generation from OEU customers interconnected to OEU's electric system; and

Whereas, the OEU desires to provide interconnection of a RGS under conditions which will insure the safety of OEU customers and employees, reliability and integrity of its distribution system;

NOW, THEREFORE, for and in consideration of the mutual covenants and agreements herein set forth, the parties hereto covenant and agree as follows:

(Continued on Sheet No. 21.1)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

1. The Customer shall be required to enter into a Tri-Party Net-Metering Purchase Power Agreement with FMPA and the City of Ocala Electric Utility (OEU).
2. "Gross power rating" (GPR) means the total manufacturer's AC nameplate generating capacity of an on-site customer-owned renewable generation system that will be interconnected to and operate in parallel with OEU's distribution facilities. For inverter-based systems, the GPR shall be calculated by multiplying the total installed DC nameplate generating capacity by 0.85 in order to account for losses during the conversion from DC to AC.
3. This agreement is strictly limited to cover a Tier 1 RGS as defined above. It is the Customer's responsibility to notify OEU of any change to the GPR of the RGS by submitting a new application for interconnection specifying the modifications at least 30 days prior to making the modifications. Increase in GPR above the ten kilowatt (10 kW) limit would necessitate entering into a new agreement at either Tier 2 or Tier 3 which may impose additional requirements on the Customer. In no case does the Tier 1, Tier 2 or Tier 3 agreement cover increases in GPR above two megawatts (2MW).
4. The RGS GPR must not exceed 90 percent (90%) of the Customer's OEU calculated distribution service rating at the Customer's location (including shared electric facilities). If the GPR does exceed the 90 percent (90%) limit, the Customer shall be responsible to pay the cost of upgrades to the distribution facilities required to accommodate the GPR capacity and ensure the 90 percent (90%) threshold is not breached. OEU will not allow a RGS GPR greater than required to offset the customer's annual kWh energy consumption (based on customer's historical consumption data or by means of estimated usage of similar type of service as determined by OEU).
5. The Customer shall not be required to pay any special fees due solely to the installation of the RGS.
6. The Customer shall fully comply with OEU's Design Standards following NEC standards as those documents may be amended or revised by OUS from time to time.
7. The Customer certifies that its installation, its operation and its maintenance shall be in compliance with the following standards (or most current version at time of inspection approval):
 - a. IEEE-1547 (2018) Standard for Interconnecting Distributed Resources with Electric Power System;
 - b. IEEE-1547.1 (2005) Standard Conformance Test Procedures for Equipment Interconnection Distributed Resources with Electric Power Systems;
 - c. UL-1741 (2010) Inverters, Converters, Controllers and Interconnection System Equipment for Use with Distributed *Energy Resources*.
 - d. The National Electric Code, state and/or local building codes, mechanical codes and/or electrical codes;
 - e. The manufacturer's installation, operation and maintenance instructions.

(Continued to Sheet No. 21.2)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

8. The Customer is not precluded from contracting for the lease, operation or maintenance of the RGS with a third party. Such lease may not provide terms or conditions that provide for any payments under the agreement to any way indicate or reflect the purchase of energy produced by the RGS. Customer shall not enter into any lease agreement that results in the retail purchase of electricity; or the retail sale of electricity from the customer-owned renewable generation. Notwithstanding this restriction, in the event that Customer is determined to have engaged in the retail purchase of electricity from a party other than OEU, then Customer shall be in breach of this Agreement and may be subject to the jurisdiction of the Florida Public Service Commission and to fines/penalties.

9. The Customer shall provide a copy of the manufacturer's installation, operation and maintenance instructions to OEU. If the RGS is leased to the Customer by a third party, or if the operation or maintenance of the RGS is to be performed by a third party, the lease and/or maintenance agreements and any pertinent documents related to these agreements shall be provided to OEU.

10. Prior to commencing parallel operation with OEU's electric system, Customer shall have the RGS inspected and approved by the appropriate code authorities having jurisdiction. Customer shall provide a copy of this inspection and approval to OEU.

11. The Customer agrees to permit OEU, if it should so choose, to inspect the RGS and its component equipment and the documents necessary to ensure compliance with this Agreement both before and after the RGS goes into service and to witness the initial testing of the RGS equipment and protective apparatus. OEU will provide Customer with as much notice as reasonably possible, either in writing, email, facsimile or by phone as to when OEU may conduct inspections and or document review. Upon reasonable notice, or at any time without notice in the event of an emergency or hazardous condition, Customer agrees to provide OEU access to the Customer's premises for any purpose in connection with the performance of the obligations required by this Agreement or, if necessary, to meet OEU's legal obligation to provide service to its customers. At least ten (10) business days prior to initially placing the customer-owned renewable generation system in service, Customer shall provide written notification to OEU advising of the date and time at which Customer intends to place the system in service, and OEU shall have the right to have personnel present on the in-service date in order to ensure compliance with the requirements of this Agreement.

(Continued on Sheet No. 21.3)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

12. The Customer's RGS must have an appropriately sized grid-tie inverter system that includes applicable protective systems. Customer certifies that the RGS equipment includes an OEU interactive inverter or interconnection system equipment that ceases to interconnect with the OEU system upon a loss of OEU's electric power. The inverter shall be considered certified for interconnected operation if it has been submitted by a manufacturer to a nationally recognized testing laboratory (NRTL) to comply with UL 1741. The NRTL shall be approved by the Occupational Safety & Health Administration (OSHA).

13. If Customer adds another RGS that (i) utilizes the same OEU interactive inverter for both systems, or (ii) utilizes a separate OEU interactive inverter for each system, Customer shall provide OEU with sixty (60) days advance written notice of the addition.

14. The Customer shall not energize the OEU system when OEU's system is deenergized. The Customer shall cease to energize the OEU system during a faulted condition on the OEU system and/or upon any notice from OEU that the deenergizing of Customer's RGS equipment is necessary. The Customer shall cease to energize the OEU system prior to automatic or non-automatic reclosing of OEU's protective devices. There shall be no intentional islanding, as described in IEEE 1547, between the Customer's and OEU' systems.

15. The Customer is responsible for the protection of its generation equipment, inverters, protection devices, and other system components from damage from the normal and abnormal operations that occur on OEU system in delivering and restoring system power. Customer agrees that any damage to any of its property, including, without limitation, all components and related accessories of its RGS system, due to the normal or abnormal operation of OEU system, is at Customer's sole risk and expense. Customer is also responsible for ensuring that the customer-owned renewable generation equipment is inspected, maintained, and tested regularly in accordance with the manufacturer's instructions to ensure that it is operating correctly and safely.

16. The Customer must install, at their expense, a manual disconnect switch of the visible load break type to provide a separation point between the AC power output of the customer-owned renewable generation system and any Customer wiring connected to OEU's system, such that back feed from the customer-owned renewable generation system to OEU's system cannot occur when the switch is in the open position. The manual disconnect switch shall be mounted separate from the meter socket on an exterior surface adjacent to the meter. The switch shall be readily accessible to OEU and capable of being locked in the open position with an OEU padlock. When locked and tagged in the open position by OEU, this switch will be under the control of OEU.

(Continued on Sheet No. 21.4)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

17. Subject to an approved inspection, including installation of acceptable disconnect switch, this Agreement shall be executed by OEU within thirty (30) calendar days of receipt of a completed application. Customer must execute this Agreement and return it to OEU at least thirty (30) calendar days prior to beginning parallel operations with OEU's electric system, subject to the requirements of Section 18, below, and within one (1) year after OEU executes this Agreement.

18. Once OEU has received Customer's written documentation that the requirements of this Agreement have been met, all agreements and documentation have been received and the correct operation of the manual switch has been demonstrated to an OEU representative, OEU will, within fifteen (15) business days, send written notice that parallel operation of the RGS may commence.

19. OEU requires the Customer to maintain general liability insurance for personal injury and property damage in the amount of not less than one hundred thousand dollars (\$100,000.00).

20. OEU will furnish, install, own and maintain metering equipment capable of measuring the flow of kilowatt-hours (kWh) of energy. The Customer's service associated with the RGS will be metered to measure the energy delivered by OEU to Customer, and measure the energy delivered by Customer to OEU. Customer agrees to provide safe and reasonable access to the premises for installation, maintenance and reading of the metering and related equipment. The Customer shall not be responsible for the cost of the installation and maintenance of the metering equipment necessary to measure the energy delivered by the Customer to OEU.

21. The Customer shall be solely responsible for all legal and financial obligations arising from the design, construction, installation, operation, maintenance and ownership of the RGS.

22. The Customer must obtain all permits, inspections and approvals required by applicable jurisdictions with respect to the generating system and must use a licensed, bonded and insured contractor to design and install the generating system. The Customer agrees to provide OEU with a copy of the local building code official inspection and certification of installation. The certification shall reflect that the local code official has inspected and certified that the installation was permitted, has been approved, and has met all electrical and mechanical qualifications.

(Continued on Sheet No. 21.5)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

23. In no event shall any statement, representation, or lack thereof, either express or implied, by OEU, relieve the Customer of exclusive responsibility for the Customer's system. Specifically, any OEU inspection of the RGS shall not be construed as confirming or endorsing the system design or its operating or maintenance procedures or as a warranty or guarantee as to the safety, reliability, or durability of the RGS. OEU's inspection, acceptance, or its failure to inspect shall not be deemed an endorsement of any RGS equipment or procedure. Further, as set forth in Sections 15 and 26 of this Agreement, Customer shall remain solely responsible for any and all losses, claims, damages and/or expenses related in any way to the operation or misoperation of its RGS equipment.

24. Notwithstanding any other provision of this Interconnection Agreement, OEU, at its sole and absolute discretion, may isolate the Customer's system from the distribution grid by whatever means necessary, without prior notice to the Customer. To the extent practical, however, prior notice shall be given. The system will be reconnected as soon as practical once the conditions causing the disconnection cease to exist. OEU shall have no obligation to compensate the Customer for any loss of energy during any and all periods when Customer's RGS is operating at reduced capacity or is disconnected from OEU's electrical distribution system pursuant to this Interconnection Agreement. Typical conditions which may require the disconnection of the Customer's system include, but are not limited to, the following:

- a. OEU system emergencies, forced outages, uncontrollable forces or compliance with prudent electric OEU practice.
- b. When necessary to investigate, inspect, construct, install, maintain, repair, replace or remove any OEU equipment, any part of OEU's electrical distribution system or Customer's generating system.
- c. Hazardous conditions existing on OEU's system due to the operation of the Customer's generation or protective equipment as determined by OEU.
- d. Adverse electrical affects (such as power quality problems) on the electrical equipment of OEU's other electric consumers caused by the Customer's generation as determined by OEU.
- e. When Customer is in breach of any of its obligations under this Interconnection Agreement or any other applicable policies and procedures of OEU.
- f. When the Customer fails to make any payments due to OEU by the due date thereof.

25. Upon termination of services pursuant to this Agreement, OEU shall open and padlock the manual disconnect switch and remove any additional metering equipment related to this Agreement. At the Customer's expense, within thirty (30) working days following the termination, the Customer shall permanently isolate the RGS and any associated equipment from OEU's electric supply system, notify OEU that the isolation is complete, and coordinate with OEU for return of OEU's lock.

(Continued to Sheet No. 21.6)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

26. To the fullest extent permitted by law, and in return for adequate, separate consideration, Customer shall indemnify, defend and hold harmless OEU, any and all of their members of its governing bodies, and its officers, agents, and employees for, from and against any and all claims, demands, suits, costs of defense, attorneys fees, witness fees of any type, losses, damages, expenses, and liabilities, whether direct, indirect or consequential, related to, arising from, or in any way connected with:

- a. Customer's design, construction, installation, inspection, maintenance, testing or operation of Customer's generating system or equipment used in connection with this Interconnection Agreement, irrespective of any fault on the part of OEU.
- b. The interconnection of Customer's generating system with, and delivery of energy from the generating system to, OEU's electrical distribution system, irrespective of any fault on the part of OEU.
- c. The performance or nonperformance of Customer's obligations under this Interconnection Agreement or the obligations of any and all of the members of Customer's governing bodies and its officers, agents, contractors (and any subcontractor or material supplier thereof) and employees.

Customer's obligations under this Section shall survive the termination of this Interconnection Agreement.

27. Customer shall not have the right to assign its benefits or obligations under this Agreement without OEU's prior written consent and such consent shall not be unreasonably withheld. If there is a change in ownership of the RGS, Customer shall provide written notice to OEU at least thirty (30) days prior to the change in ownership. The new owner will be required to assume, in writing, the Customer's rights and duties under this Agreement, or execute a new Standard Interconnection Agreement. The new owner shall not be permitted to net meter or begin parallel operations until the new owner assumes this Agreement or executes a new Agreement.

28. This Agreement supersedes all previous agreements and representations either written or verbal heretofore made between OEU and Customer with respect to matters herein contained. This Agreement, when duly executed, constitutes the only Agreement between parties hereto relative to the matters herein described. This Agreement shall continue in effect from year to year until either party gives sixty (60) days' notice of its intent to terminate this Agreement.

(Continued on Sheet No. 21.7)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

29. This Agreement shall be governed by and construed and enforced in accordance with the laws, rules and regulations of the State of Florida and OEU's tariff as it may be modified, changed, or amended from time to time, including any amendments modification or changes to OEU's Net-Metering Service Rate Schedule, the schedule applicable to this Agreement. The Customer and OEU agree that any action, suit, or proceeding arising out of or relating to this Interconnection Agreement shall be initiated and prosecuted in the state court of competent jurisdiction located in Marion County, Florida, and OEU and the Customer irrevocably submit to the jurisdiction and venue of such court. To the fullest extent permitted by law, each Party hereby irrevocably waives any and all rights to a trial by jury and covenants and agrees that it will not request a trial by jury with respect to any legal proceeding arising out of or relating to this Interconnection Agreement.

None of the provisions of this Interconnection Agreement shall be considered waived by either Party except when such waiver is given in writing. No waiver by either Party of any one or more defaults in the performance of the provisions of this Interconnection Agreement shall operate or be construed as a waiver of any other existing or future default or defaults. If any one or more of the provisions of this Interconnection Agreement or the applicability of any provision to a specific situation is held invalid or unenforceable, the provision shall be modified to the minimum extent necessary to make it or its application valid and enforceable, and the validity and enforceability of all other provisions of this Interconnection Agreement and all other applications of such provisions shall not be affected by any such invalidity or unenforceability. This Interconnection Agreement does not govern the terms and conditions for the delivery of power and energy to non-generating retail customers of OEU's electrical distribution system.

30. This Agreement incorporates by reference the terms of the tariff filed with the Florida Public Service Commission by OEU, including OEU's Net-Metering Service Rate Schedule, and associated technical terms and abbreviations, general rules and regulations and standard electric service requirements (as may be applicable) are incorporated by reference, as amended from time to time. To the extent of any conflict between this Agreement and such tariff, the tariff shall control.

31. OEU and Customer recognize that the Florida Statutes and/or the Florida Public Service Commission Rules, including those directly addressing the subject of this Agreement, may be amended from time to time. In the event that such statutes and/or rules are amended that affect the terms and conditions of this Agreement, OEU and Customer agree to supersede and replace this Agreement with a new Interconnection Agreement, which complies with the amended statutes/rules.

(Continued on Sheet No. 21.8)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

OCALA ELECTRIC UTILITY
OCALA, FLORIDA
(Continued from Sheet No. 21.7)

FIRST REVISED SHEET NO. 21.8
CANCELS ORIGINAL SHEET NO. 21.8

32. Customer acknowledges that its provision of electricity to OEU hereunder is on a first-offered, first-accepted basis and subject to diminution and/or rejection in the event the total amount of electricity delivered to OEU pursuant to the OEU's Net-Metering Service Rate Schedule, (as filed with the Florida Public Service Commission), from all participating OEU customers, exceeds two and one-half percent (2.5%) of the aggregate customer peak demand on the OEU system.

33. This Agreement is solely for the benefit of OEU and Customer and no right nor any cause of action shall accrue upon or by reason, to or for the benefit of any third party not a formal party to this Agreement. Nothing in this Agreement, expressed or implied, is intended or shall be construed to confer upon any person or corporation other than OEU or Customer, any right, remedy, or claim under or by reason of this Agreement or any of the provisions or conditions of this Agreement; and, all provisions, representations, covenants, and conditions contained in this Agreement shall inure to the sole benefit of and be binding upon OEU and Customer and their respective representatives, successors, and assigns. Further, no term or condition contained in this Agreement shall be construed in any way as a waiver by OEU of the sovereign immunity applicable to OEU as established by Florida Statutes, 768.28.

(Continued on Sheet No. 21.9)

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

OCALA ELECTRIC UTILITY
OCALA, FLORIDA
(Continued from Sheet No. 21.8)

FIRST REVISED SHEET NO. 21.9
CANCELS ORIGINAL SHEET NO. 21.9

IN WITNESS WHEREOF, Customer and OEU have executed this Agreement the day and year first above written.

City of Ocala Electric Utility:

By: Ken Whitehead

Title: Asst. City Manager

Date: 02 / 15 / 2023

Customer:

By: Jenelle Dadyard
(Print Name)

[Signature]
(Signature)

Date: 3-1-22

City of Ocala Electric Utility Account Number:

528795-151146

Approved as to form and legality:

William E. Sexton

William E. Sexton
City Attorney

Issued by: Michael Poucher, P.E.
Electric Utility Director

Effective: October 1, 2019

Title	FOR SIGNATURES - Application for Interconnection of.....
File name	2779_001.pdf
Document ID	23a23d8b17422fb523f61cc24559dd704247e1b3
Audit trail date format	MM / DD / YYYY
Status	● Signed

Document History



02 / 13 / 2023
16:26:09 UTC-5

Sent for signature to William E. Sexton (wssexton@ocalafl.org), Ken Whitehead (kwhitehead@ocalafl.org) and Florida Municipal Power Agency (chris.gowder@fmpa.com) from slewis@ocalafl.org
IP: 216.255.240.104



02 / 13 / 2023
16:26:32 UTC-5

Viewed by William E. Sexton (wssexton@ocalafl.org)
IP: 40.94.29.159



02 / 14 / 2023
16:49:21 UTC-5

Signed by William E. Sexton (wssexton@ocalafl.org)
IP: 216.255.240.104



02 / 15 / 2023
09:15:44 UTC-5

Viewed by Ken Whitehead (kwhitehead@ocalafl.org)
IP: 216.255.240.104



02 / 15 / 2023
09:18:15 UTC-5

Signed by Ken Whitehead (kwhitehead@ocalafl.org)
IP: 216.255.240.104

Title	FOR SIGNATURES - Application for Interconnection of.....
File name	2779_001.pdf
Document ID	23a23d8b17422fb523f61cc24559dd704247e1b3
Audit trail date format	MM / DD / YYYY
Status	● Signed

Document History



02 / 15 / 2023
13:38:12 UTC-5

Viewed by Florida Municipal Power Agency
(chris.gowder@fmpa.com)
IP: 172.58.111.217



02 / 15 / 2023
13:38:33 UTC-5

Signed by Florida Municipal Power Agency
(chris.gowder@fmpa.com)
IP: 172.58.111.217



02 / 15 / 2023
13:38:33 UTC-5

The document has been completed.